



February 23, 2023

Associate Director, Water Enforcement
U.S. Environmental Protection Agency
Region VI
1201 Elm Street, Suite 500
Mail Code ECADW
Dallas, Texas 75270-2102

Via USPS Certified Mail
7021 1970 0000 7631 8428
Via E-mail: Smalley.bryant@epa.gov

Re: City of Houston Wastewater Consent Decree
Civil Action No. 4:18-cv-03368
Monthly SSO Report – January 2023

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for January 2023 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Sincerely,

DocuSigned by:
A handwritten signature in black ink, appearing to read "Phillip Goodwin".
09B3519C2697428...

Phillip Goodwin
Regulatory Compliance Director
Houston Public Works, City of Houston

Enc. January 2023 Monthly SSO Report; SSO Map for January 2023
cc via email: Nathaniel Douglas, DOJ (Nathaniel.douglas@usdoj.gov)
James Zimny, EPA (Zimny.james@epa.gov)
Alan Vaughn, EPA (vaughn.alan@epa.gov)
Phillip Ledbetter, Texas AG's Office (phillip.ledbetter@oag.texas.gov);
James Sallans, TCEQ (james.sallans@tceq.texas.gov)
Kristen Schlemmer, BCWK (kristen@bayoucitywaterkeeper.org)

PO Box 1562 | Houston, Texas 77251-1562 | HoustonPublicWorks.org



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2023

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50555	WQ0010495090	2305 CENTER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	137	Manhole	Grease Blockage	1/1/2023	10:38	1/1/2023	12:55	1	Cleaned and Disinfected;Cleared Main Line
50556	WQ0010495030	7521 PAGEWOOD LN	Storm Sewer (not contained)	Storm Sewer (not contained)	2250	Manhole	Grease Blockage	1/1/2023	15:45	1/2/2023	10:30	2	Cleaned and Disinfected;Cleared Private Line
50558	WQ0010495037	5504 SHADOW CREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/2/2023	9:06	1/2/2023	9:07	0	Cleaned and Disinfected;Cleared Service Lateral
50562	WQ0010495090	4219 EDISON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Service Lateral	Collection system structural failure	1/2/2023	9:30	1/2/2023	9:31	0	Cleared City Clean Out;Cleaned and Disinfected;Set Bypass Pump
50563	WQ0010495090	2074 ANTOINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Collection system structural failure	1/2/2023	9:51	1/2/2023	9:52	0	Cleared City Cleanout;Cleaned and Disinfected;Set Bypass Pump
50564	WQ0010495090	410 LONGWOODS LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Force Main	Collection system structural failure	1/2/2023	11:04	1/2/2023	11:05	0	Cleaned and Disinfected;Cleared Private Line
50571	WQ0010495090	9716 EDGEWORTH ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Grease Blockage	1/2/2023	15:40	1/2/2023	15:41	0	Cleared Service Lateral;Cleaned and Disinfected
50579	WQ0010495037	10627 ALBURY DR	Storm Sewer (not contained)	Storm Sewer (not contained)	251	Manhole	Grease Blockage	1/3/2023	9:35	1/3/2023	13:46	1	Cleaned and Disinfected;Cleared Private Line
50582	WQ0010495090	330 HARBOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/3/2023	10:57	1/3/2023	10:58	0	Cleaned and Disinfected;Cleared Private Line
50585	WQ0010495090	7324 EAGLE PASS ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Rags/Wipes	1/3/2023	11:21	1/3/2023	11:22	0	Cleaned and Disinfected;Cleared City Clean Out
50586	WQ0010495090	5512 BUNTE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Rags/Wipes	1/3/2023	11:30	1/3/2023	11:31	0	Cleaned and Disinfected;Cleared Private Line
50588	WQ0010495090	5202 A FLOYD ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	Manhole	Grease Blockage	1/3/2023	12:08	1/3/2023	12:09	0	Cleaned and Disinfected;Cleared Service Lateral
50591	WQ0010495119	10275 GREENFORK DR	Storm Sewer (not contained)	Storm Sewer (not contained)	333	Manhole	Grease Blockage	1/3/2023	13:24	1/3/2023	15:15	3	Cleared Private Line;Cleaned and Disinfected
50594	WQ0010495090	723 SHOTWELL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	228	Manhole	Grease Blockage	1/3/2023	15:36	1/3/2023	17:30	2	Cleaned and Disinfected;Cleared Main Line
50595	WQ0010495002	5219 PENFIELD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/3/2023	16:24	1/3/2023	16:25	0	Cleaned and Disinfected;Cleared Main Line
50601	WQ0010495002	7550 EL RANCHO ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/4/2023	9:07	1/4/2023	9:08	0	Cleared Main Line;Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50605	WQ0010495109	1556 PRAIRIE GROVE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/4/2023	10:40	1/4/2023	10:41	0	Cleaned and Disinfected;Cleared Main Line
50619	WQ0010495016	8915 COMPTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/4/2023	14:38	1/4/2023	14:39	0	Cleared Service Lateral;Cleaned and Disinfected
50622	WQ0010495101	15107 WELLMAN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	1163	Private Cleanout	Grease Blockage	1/4/2023	16:56	1/5/2023	12:19	1	Cleaned and Disinfected;Cleared Main Line
50625	WQ0010495090	3410 OAK FOREST DR	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	Service Lateral	Grease Blockage	1/5/2023	9:46	1/5/2023	9:47	0	Cleared Private Line;Cleaned and Disinfected
50629	WQ0010495090	1216 NORTHWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Collection system structural blockage	1/5/2023	11:42	1/5/2023	11:43	0	Cleaned and Disinfected;Cleared Main Line
50631	WQ0010495090	11607 NORTHWEST FWY	Storm Sewer (not contained)	Storm Sewer (not contained)	1425	Manhole	Grease Blockage	1/5/2023	13:29	1/6/2023	13:14	1	Cleaned and Disinfected;Cleared Main Line
50632	WQ0010495076	8600 JAMEEL RD	Storm Sewer (not contained)	Storm Sewer (not contained)	4083	Manhole	Grease Blockage	1/5/2023	13:19	1/6/2023	12:00	3	Cleared Private Line;Cleaned and Disinfected
50637	WQ0010495030	7521 PAGEWOOD LN	Storm Sewer (not contained)	Storm Sewer (not contained)	5490	Manhole	Grease Blockage	1/5/2023	15:57	1/6/2023	10:15	5	Cleaned and Disinfected;Cleared Main Line
50638	WQ0010495016	9555 CROFTON ST	Storm Sewer (not contained)	Storm Sewer (not contained)	5468	Manhole	Grease Blockage	1/5/2023	16:46	1/7/2023	14:20	2	Cleaned and Disinfected;Cleared Main Line
50644	WQ0010495090	8563 MONTRIDGE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/6/2023	10:43	1/6/2023	10:44	0	Cleaned and Disinfected;Cleared City Clean Out
50646	WQ0010495090	609 SCHWEIKHARDT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Grease Blockage	1/6/2023	10:25	1/6/2023	10:26	0	Cleaned and Disinfected;Cleared Main Line
50648	WQ0010495090	5213 LYONS AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/6/2023	11:22	1/6/2023	11:23	0	Cleaned and Disinfected;Cleared City Clean Out
50649	WQ0010495090	7725 AVENUE F	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Collection system structural blockage	1/6/2023	12:01	1/6/2023	12:02	0	Cleared City Clean Out;Cleaned and Disinfected
50653	WQ0010495090	1031 VOIGHT ST	Storm Sewer (not contained)	Storm Sewer (not contained)	153	Manhole	Grease Blockage	1/6/2023	15:17	1/6/2023	17:50	1	Cleaned and Disinfected;Cleared Main Line
50659	WQ0010495119	10903 RADFORD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/6/2023	16:34	1/6/2023	16:35	0	Cleaned and Disinfected;Cleared Main Line;Set bypass pump

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50665	WQ0010495148	8602 VALLEY SONG DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Collection system temporary blockage	1/7/2023	15:46	1/7/2023	15:47	0	Cleaned and Disinfected;Cleared Main Line
50666	WQ0010495002	7718 GRAHAMCREST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	526	Manhole	Grease Blockage	1/8/2023	8:08	1/8/2023	12:31	2	Cleaned and Disinfected;Cleared Main Line
50668	WQ0010495090	711 SCHWEIKART ST	Storm Sewer (not contained)	Storm Sewer (not contained)	145	Manhole	Collection system temporary blockage	1/8/2023	9:31	1/8/2023	10:00	5	Cleaned and Disinfected
50670	WQ0010495003	307 FAIRVIEW AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/8/2023	10:28	1/8/2023	10:29	0	Cleaned and Disinfected;Cleared City Clean Out
50676	WQ0010495003	12614 SKYVIEW CREEK CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	466	Manhole	Grease Blockage	1/8/2023	9:07	1/8/2023	13:00	2	Cleaned and Disinfected;Cleared Main Line
50686	WQ0010495077	730 AUTUMNWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/9/2023	12:54	1/9/2023	12:55	0	Cleared Main Line;Cleaned and Disinfected
50689	WQ0010495119	9009 RICHMOND AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	107	Manhole	Grease Blockage	1/9/2023	13:55	1/9/2023	17:30	0	Cleaned and Disinfected;Cleared Main Line
50690	WQ0010495090	1214 NORTHWOOD ST	Storm Sewer (not contained)	Storm Sewer (not contained)	886	Manhole	Collection system structural blockage	1/9/2023	9:07	1/9/2023	16:30	2	Cleaned and Disinfected;Cleared Main Line
50694	WQ0010495090	1201 SPRING ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Collection system ? wet weather	1/9/2023	14:17	1/9/2023	14:18	0	Cleaned and Disinfected
50697	WQ0010495090	2419 PANNELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/9/2023	15:49	1/9/2023	15:50	0	Cleared City Clean Out;Cleaned and Disinfected
50700	WQ0010495090	4113 PARKER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	1287	Manhole	Grease Blockage	1/9/2023	16:10	1/11/2023	11:05	0	Cleaned and Disinfected;Cleared Main Line
50701	WQ0010495090	5202 DARLING ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	1105	Manhole	Grease Blockage	1/9/2023	16:47	1/10/2023	11:12	1	Cleaned and Disinfected;Cleared Main Line



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2023

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50705	WQ0010495002	1015 VILLA DE MATEL RD	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Manhole	Rags/Wipes	1/11/2023	14:00	1/11/2023	14:50	0	Cleaned and Disinfected;Cleared Main Line
50706	WQ0010495090	9106 E HARDY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/10/2023	8:38	1/10/2023	8:39	0	Cleared Service Lateral;Cleaned and Disinfected
50708	WQ0010495111	11403 TRIOLA LN	Contained On Site	Contained On Site	0	Service Lateral	Collection system structural failure	1/10/2023	9:13	1/10/2023	9:14	0	Set Bypass Pump;Cleaned and Disinfected
50709	WQ0010495002	2120 WALKER ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Manhole	Grease Blockage	1/10/2023	9:27	1/10/2023	9:28	0	Cleared Main Line;Cleaned and Disinfected
50714	WQ0010495077	705 EVANSTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/10/2023	12:05	1/10/2023	12:06	0	Cleared City Clean Out;Cleaned and Disinfected
50726	WQ0010495002	4023 ANTOINETTE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Roots	1/10/2023	17:33	1/10/2023	17:34	0	Set Bypass Pump;Cleaned and Disinfected
50729	WQ0010495002	6606 KELLER ST	Storm Sewer (not contained)	Storm Sewer (not contained)	2235	Manhole	Grease Blockage	1/11/2023	7:48	1/11/2023	15:15	5	Cleaned and Disinfected;Cleared Main Line
50731	#N/A	5946 VAN FLEET ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	59	Manhole	Grease Blockage	1/10/2023	10:30	1/10/2023	11:29	1	Cleaned and Disinfected;Cleared Main Line
50735	WQ0010495090	6823 MORROW ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Grease Blockage	1/11/2023	10:43	1/11/2023	10:44	0	Cleared City Clean Out;Cleaned and Disinfected
50736	WQ0010495109	1556 PRAIRIE GROVE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Rags/Wipes	1/11/2023	10:38	1/11/2023	10:39	0	Cleared Service Lateral;Cleaned and Disinfected
50741	WQ0010495110	4703 BRYANT RIDGE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/10/2023	12:57	1/10/2023	12:58	0	Cleared Main Line;Cleaned and Disinfected
50742	WQ0010495090	8007 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	2260	Manhole	Pump/Lift Station Electrical Failure	1/11/2023	11:47	1/11/2023	13:40	20	Cleaned and Disinfected
50744	WQ0010495076	14031 NORTHWEST FWY	Storm Sewer (not contained)	Storm Sewer (not contained)	1107	Manhole	Grease Blockage	1/11/2023	14:26	1/13/2023	3:20	1	Cleaned and Disinfected
50747	WQ0010495090	7947 CAPITOL ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	462	Manhole	Pump/Lift Station Electrical Failure	1/11/2023	11:47	1/11/2023	13:04	6	Cleaned and Disinfected
50748	WQ0010495090	7947 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	616	Manhole	Pump/Lift Station Electrical Failure	1/11/2023	11:47	1/11/2023	13:04	8	Cleaned and Disinfected
50749	WQ0010495090	7947 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	77	Manhole	Pump/Lift Station Electrical Failure	1/11/2023	11:47	1/11/2023	13:04	1	Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50752	WQ0010495076	4923 CRANSWICK RD	Storm Sewer (not contained)	Storm Sewer (not contained)	1027	Manhole	Collection system structural blockage	1/11/2023	17:32	1/13/2023	3:59	0	Set Bypass Pump;Cleaned and Disinfected
50753	WQ0010495111	12058 WHITE CAP LN	Storm Sewer (not contained)	Storm Sewer (not contained)	993	Manhole	Grease Blockage	1/11/2023	17:26	1/12/2023	9:59	1	Cleared Main Line;Cleaned and Disinfected
50758	WQ0010495030	439 W GAYWOOD DR	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	City Cleanout	Collection system structural failure	1/12/2023	10:14	1/12/2023	10:15	0	Cleared Service Lateral;Cleaned and Disinfected
50762	WQ0010495016	7931 CLAIRBORNE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Service Lateral	Collection system structural failure	1/12/2023	12:02	1/12/2023	12:03	0	Cleaned and Disinfected
50764	WQ0010495090	2407 PANNELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Grease Blockage	1/12/2023	13:37	1/12/2023	13:38	0	Cleared Main Line;Cleaned and Disinfected
50766	WQ0010495119	3230 GESSNER RD	Storm Sewer (not contained)	Storm Sewer (not contained)	303	Manhole	Grease Blockage	1/12/2023	16:09	1/12/2023	17:50	3	Cleared Main Line;Cleaned and Disinfected
50767	WQ0010495077	12477 STRICK LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/12/2023	16:28	1/12/2023	16:29	0	Cleared Main Line;Cleaned and Disinfected
50769	WQ0010495100	13139 NORTH FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	7500	Manhole	Pump/Lift station instrumentation failure	1/10/2023	17:47	1/10/2023	23:48	21	Cleaned and Disinfected
50774	WQ0010495002	4019 ANTOINETTE ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	City Cleanout	Collection system temporary blockage	1/13/2023	10:47	1/13/2023	10:48	0	Cleaned and Disinfected
50780	WQ0010495079	8951 SUMMERSET MEADOW CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Service Lateral	Collection system structural failure	1/13/2023	15:06	1/13/2023	15:07	0	Cleaned and Disinfected
50781	WQ0010495090	5301 COLLINGSWORTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/13/2023	17:10	1/13/2023	17:11	0	Cleaned and Disinfected;Cleared Service Lateral
50786	WQ0010495009	5638 SOUTHBROOK DR	Storm Sewer (not contained)	Storm Sewer (not contained)	740	Manhole	Grease Blockage	1/15/2023	8:21	1/15/2023	13:17	3	Cleaned and Disinfected;Cleared Main Line
50791	WQ0010495002	7816 E MAGNOLIA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Service Lateral	Collection system structural blockage	1/15/2023	14:32	1/15/2023	14:33	0	Cleared Service Lateral;Cleaned and Disinfected
50794	WQ0010495075	11218 SAGEWILLOW LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Grease Blockage	1/16/2023	8:51	1/16/2023	8:52	0	Cleaned and Disinfected;Cleared Main Line



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2023

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50796	WQ0010495077	6502 HAWKEYE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Grease Blockage	1/16/2023	14:50	1/16/2023	14:51	0	Cleaned and Disinfected;Cleared Main Line
50802	WQ0010495037	6058 CRAB ORCHARD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Gravity Main	Grease Blockage	1/16/2023	15:37	1/16/2023	15:38	0	Cleared Main Line;Cleaned and Disinfected
50803	WQ0010495010	242 OWENS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Grease Blockage	1/16/2023	15:37	1/16/2023	15:38	0	Cleared Main Line;Cleaned and Disinfected
50804	WQ0010495037	6232 AIRPORT BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	83	Manhole	Grease Blockage	1/17/2023	8:18	1/17/2023	13:50	0	Cleared Main Line;Cleaned and Disinfected
50806	WQ0010495002	614 S WAYSIDE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	6468	Manhole	Collection system structural failure	1/17/2023	10:21	1/19/2023	16:15	18	Set Bypass Pump;Cleaned and Disinfected
50813	WQ0010495111	7815 SUN RISE LN	Storm Sewer (not contained)	Storm Sewer (not contained)	1629	Manhole	Grease Blockage	1/17/2023	12:09	1/18/2023	15:18	1	Cleaned and Disinfected;Cleared Main Line
50816	WQ0010495090	1655 NORFOLK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	168	Manhole	Grease Blockage	1/17/2023	11:50	1/17/2023	14:38	1	Cleaned and Disinfected;Cleared Main Line
50820	WQ0010495037	12207 CARRSWOLD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/17/2023	9:38	1/17/2023	9:39	0	Cleaned and Disinfected;Cleared Main Line
50823	WQ0010495119	9811 SOUTHWEST FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/17/2023	15:42	1/17/2023	15:43	0	Cleared City Clean Out;Cleaned and Disinfected
50824	WQ0010495099	7142 YELLOW PINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	1309	Service Lateral	Grease Blockage	1/17/2023	15:28	1/18/2023	13:17	1	Cleaned and Disinfected;Cleared Main Line
50825	WQ0010495090	4509 WIPPRECHT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/17/2023	16:24	1/17/2023	16:25	0	Cleaned and Disinfected;Cleared City Clean Out
50828	WQ0010495076	5815 W LITTLE YORK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Rags/Wipes	1/17/2023	16:55	1/17/2023	16:56	0	Cleaned and Disinfected;Cleared Main Line

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50829	WQ0010495090	155 COOPER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Collection system structural failure	1/17/2023	16:53	1/17/2023	16:54	0	Cleaned and Disinfected
50831	WQ0010495002	5800 SOUTHMUND ST	Storm Sewer (not contained)	Storm Sewer (not contained)	214	Manhole	Grease Blockage	1/18/2023	8:19	1/18/2023	10:06	2	Cleaned and Disinfected;Cleared Main Line
50833	WQ0010495111	10575 WESTPARK DR	Storm Sewer (not contained)	Storm Sewer (not contained)	340	Manhole	Grease Blockage	1/18/2023	8:46	1/18/2023	11:36	2	Cleared Main Line;Cleaned and Disinfected
50836	WQ0010495030	20 WICKERBAY ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	Gravity Main	Collection system structural blockage	1/18/2023	9:14	1/18/2023	9:15	0	Cleaned and Disinfected;Set Bypass Pump
50838	WQ0010495100	13139 NORTH FWY	Storm Sewer (not contained)	Storm Sewer (not contained)	5450	Manhole	Pump/Lift station instrumentation failure	1/15/2023	18:17	1/15/2023	21:55	25	Cleaned and Disinfected
50845	WQ0010495119	8914 TRIOLA LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Collection system structural failure	1/17/2023	16:31	1/17/2023	16:32	0	Set Bypass Pump;Cleaned and Disinfected
50848	WQ0010495076	5353 DEEP FOREST DR	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Service Lateral	Grease Blockage	1/18/2023	13:31	1/18/2023	13:32	0	Cleared Main Line;Cleaned and Disinfected
50857	WQ0010495003	1842 W ALABAMA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	518	Gravity Main	Collection system structural failure	1/18/2023	15:02	1/20/2023	1:32	0	Set Bypass Pump;Cleaned and Disinfected
50860	WQ0010495090	3333 KATY FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	103	Manhole	Rags/Wipes	1/18/2023	16:27	1/18/2023	18:10	1	Cleaned and Disinfected;Cleared Main Line
50862	WQ0010495090	7003 AVENUE H	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Collection system structural blockage	1/19/2023	9:31	1/19/2023	9:32	0	Cleared City Clean Out;Cleaned and Disinfected
50864	WQ0010495119	7518 GRAPE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	520	Manhole	Grease Blockage	1/19/2023	9:15	1/19/2023	13:35	2	Cleared Main Line;Cleaned and Disinfected
50872	WQ0010495111	12235 WHITE CAP LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	2776	City Cleanout	Collection system structural failure	1/19/2023	11:57	1/20/2023	11:05	2	Cleared Service Lateral;Cleaned and Disinfected
50874	WQ0010495037	2134 BINGLE RD	Storm Sewer (not contained)	Storm Sewer (not contained)	672	Manhole	Grease Blockage	1/19/2023	12:49	1/19/2023	18:25	2	Cleaned and Disinfected;Cleared Main Line
50882	WQ0010495139	5203 E PAGEWICK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/20/2023	10:50	1/20/2023	10:51	0	Cleaned and Disinfected;Cleared Main Line
50885	WQ0010495090	6522 GAINESVILLE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Grease Blockage	1/21/2023	13:50	1/21/2023	13:51	0	Cleaned and Disinfected;Cleared City Clean Out
50889	WQ0010495090	1439 PRINCE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Manhole	Grease Blockage	1/21/2023	14:38	1/21/2023	14:39	0	Cleaned and Disinfected;Cleared Main Line

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50893	WQ0010495090	2126 BAUER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Rags/Wipes	1/22/2023	15:39	1/22/2023	15:40	0	Cleared City Clean Out;Cleaned and Disinfected
50895	WQ0010495090	5416 DICKSON ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Rags/Wipes	1/23/2023	9:12	1/23/2023	9:13	0	Cleared Service Lateral;Cleaned and Disinfected
50896	WQ0010495077	851 FEDERAL RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/23/2023	9:21	1/23/2023	9:22	0	Cleared Main Line;Cleaned and Disinfected
50902	WQ0010495090	4720 MONROSE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	184	City Cleanout	Grease Blockage	1/23/2023	11:19	1/23/2023	12:51	2	Cleaned and Disinfected;Cleared Service Lateral
50904	WQ0010495030	12326 BARRYKNOLL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	1409	Manhole	Grease Blockage	1/23/2023	12:49	1/25/2023	11:48	0	Cleaned and Disinfected;Cleared Main Line
50907	WQ0010495090	2312 TERRY ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	City Cleanout	Collection system structural failure	1/23/2023	14:42	1/23/2023	14:43	0	Cleaned and Disinfected;Set Bypass Pump
50909	WQ0010495090	602 E 42ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Service Lateral	Collection system structural failure	1/23/2023	15:59	1/23/2023	16:00	0	Cleaned and Disinfected;Set Bypass Pump
50914	WQ0010495111	7822 SUN RISE LN	Storm Sewer (not contained)	Storm Sewer (not contained)	68	Manhole	Grease Blockage	1/24/2023	10:02	1/24/2023	11:10	1	Cleaned and Disinfected;Cleared Main Line
50916	WQ0010495090	3422 VINTAGE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Service Lateral	Collection system structural failure	1/24/2023	11:23	1/24/2023	11:24	0	Cleaned and Disinfected
50917	WQ0010495037	8435 WESTGLEN DR	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Manhole	Grease Blockage	1/24/2023	13:05	1/25/2023	12:35	0	Cleaned and Disinfected;Cleared Main Line
50918	WQ0010495090	1301 WAYSIDE DR	Storm Sewer (not contained)	Storm Sewer (not contained)	8640	Manhole	Collection system ? wet weather	1/24/2023	15:26	1/24/2023	20:52	27	Cleaned and Disinfected;Post Warning Signs
50919	WQ0010495090	6800 LYONS AVE	Storm Sewer (not contained)	Storm Sewer (not contained)	4314	Manhole	Collection system ? wet weather	1/24/2023	15:45	1/24/2023	20:52	14	Post Warning Signs;Cleaned and Disinfected
50920	WQ0010495002	1006 HACKNEY ST	Storm Sewer (not contained)	Storm Sewer (not contained)	2100	Manhole	Collection system ? wet weather	1/24/2023	16:29	1/24/2023	17:39	30	Post Warning Signs;Cleaned and Disinfected
50922	WQ0010495002	6335 BROOKSIDE DR	Storm Sewer (not contained)	Storm Sewer (not contained)	810	Manhole	Collection system ? wet weather	1/24/2023	16:45	1/24/2023	17:38	15	Post Warning Signs;Cleaned and Disinfected
50923	WQ0010495146	22 DEER RIDGE ESTATES BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	20	Lift Station	Power Outage	1/24/2023	17:12	1/24/2023	17:22	2	Cleaned and Disinfected
50924	WQ0010495090	8007 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	1320	Manhole	Power Outage	1/24/2023	19:38	1/24/2023	20:22	30	Cleaned and Disinfected
50925	WQ0010495090	7947 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	440	Manhole	Power Outage	1/24/2023	19:38	1/24/2023	20:22	10	Cleaned and Disinfected
50926	WQ0010495090	7947 CAPITOL ST	Storm Sewer (not contained)	Storm Sewer (not contained)	220	Manhole	Power Outage	1/24/2023	19:38	1/24/2023	20:22	5	Cleaned and Disinfected

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50927	WQ0010495090	1443 BLAIR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/25/2023	8:52	1/25/2023	8:53	0	Cleared City Clean Out; Cleaned and Disinfected
50931	WQ0010495079	8302 GULF TREE LN	Storm Sewer (not contained)	Storm Sewer (not contained)	514	Manhole	Grease Blockage	1/25/2023	9:28	1/25/2023	13:45	2	Cleaned and Disinfected; Cleared Main Line
50935	WQ0010495146	2302 STALEY OAK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Power Outage	1/25/2023	10:44	1/25/2023	10:45	0	Cleaned and Disinfected; Contain All or Portion of Spill
50937	WQ0010495090	1201 SPRING ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	Manhole	Collection system ? wet weather	1/25/2023	11:51	1/25/2023	11:52	0	Cleaned and Disinfected
50949	WQ0010495002	7901 LEONORA ST	Storm Sewer (not contained)	Storm Sewer (not contained)	576	Private Cleanout	Collection system structural blockage	1/26/2023	8:30	1/26/2023	13:18	2	Cleaned and Disinfected; Set Bypass Pump
50950	WQ0010495002	1325 MUNGER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Grease Blockage	1/26/2023	13:58	1/26/2023	13:59	0	Cleared City Clean Out; Cleaned and Disinfected
50956	WQ0010495030	7509 1/2 PAGEWOOD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	430	Manhole	Grease Blockage	1/26/2023	16:55	1/26/2023	20:30	2	Cleared Main Line; Cleaned and Disinfected
50957	WQ0010495002	6747 LAWDALE ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	0	Gravity Main	Collection system temporary blockage	1/24/2023	19:00	1/24/2023	19:01	0	Cleaned and Disinfected; Post Warning Signs
50966	WQ0010495002	4902 PERSHING ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Collection system structural blockage	1/27/2023	13:52	1/27/2023	13:53	0	Cleared Service Lateral; Cleaned and Disinfected
50959	WQ0010495090	8550 GUINEVERE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	608	Manhole	Grease Blockage	1/27/2023	10:06	1/27/2023	15:10	2	Cleaned and Disinfected; Cleared Main Line
50960	WQ0010495090	2914 STAPLES ST	Storm Sewer (not contained)	Storm Sewer (not contained)	730	City Cleanout	Collection system structural failure	1/27/2023	10:45	1/27/2023	16:50	2	Cleaned and Disinfected; Cleared City Clean Out
50963	WQ0010495076	7835 GROW LN	Storm Sewer (not contained)	Storm Sewer (not contained)	1294	Manhole	Collection system temporary blockage	1/27/2023	11:26	1/28/2023	9:00	1	Cleaned and Disinfected
50967	WQ0010495075	10906 SAGETRAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/27/2023	13:04	1/27/2023	13:05	0	Cleaned and Disinfected; Cleared Main Line
50971	WQ0010495002	2101 POLK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Private Cleanout	Rags/Wipes	1/28/2023	8:36	1/28/2023	8:37	0	Cleared Main Line; Cleaned and Disinfected




City of Houston - Houston Public Works
 Monthly SSO Report
 January 2023

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
50973	WQ0010495076	6343 FRENCH CHATEAU DR	Storm Sewer (not contained)	Storm Sewer (not contained)	1572	Manhole	Grease Blockage	1/28/2023	10:52	1/29/2023	13:04	1	Cleaned and Disinfected;Cleared Main Line
50974	WQ0010495003	14875 WATERLOO DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	City Cleanout	Roots	1/28/2023	12:11	1/28/2023	12:12	0	Cleaned and Disinfected;Cleared Main Line
50976	WQ0010495090	5810 VAN ZANDT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	6320	Manhole	Grease Blockage	1/28/2023	13:00	1/30/2023	17:40	2	Cleared Main Line;Cleaned and Disinfected
50979	WQ0010495090	2600 TRAVIS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	20	City Cleanout	Grease Blockage	1/29/2023	9:41	1/29/2023	9:51	2	Cleaned and Disinfected;Cleared Service Lateral
50982	WQ0010495016	7703 TRAVIS PARK LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	0	Manhole	Grease Blockage	1/29/2023	11:25	1/29/2023	11:26	0	Cleared Service Lateral;Cleaned and Disinfected
50987	WQ0010495109	1200 DAIRY ASHFORD RD	Storm Sewer (not contained)	Storm Sewer (not contained)	208	Manhole	Grease Blockage	1/30/2023	9:56	1/30/2023	13:24	1	Cleaned and Disinfected;Cleared Main Line
50991	WQ0010495119	11502 VANDERFORD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	670	Manhole	Grease Blockage	1/30/2023	11:16	1/30/2023	16:51	2	Cleaned and Disinfected;Cleared Main Line
50996	WQ0010495090	5810 VAN ZANDT ST	Storm Sewer (not contained)	Storm Sewer (not contained)	352	City Cleanout	Grease Blockage	1/30/2023	15:44	1/30/2023	18:40	2	Cleared Main Line;Cleaned and Disinfected
51000	WQ0010495077	13313 VICKSBURG ST	Bayou/surface water/drainage ditch	Bayou/surface water/drainage ditch	27795	Manhole	Collection system structural failure	1/31/2023	8:24	2/2/2023	22:10	8	Cleaned and Disinfected;Set Bypass Pump
51008	WQ0010495090	2401 MILWAUKEE ST	Storm Sewer (not contained)	Storm Sewer (not contained)	0	City Cleanout	Grease Blockage	1/31/2023	15:12	1/31/2023	15:13	0	Cleared City Clean Out;Cleaned and Disinfected

Total Number of SSOs:	143
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

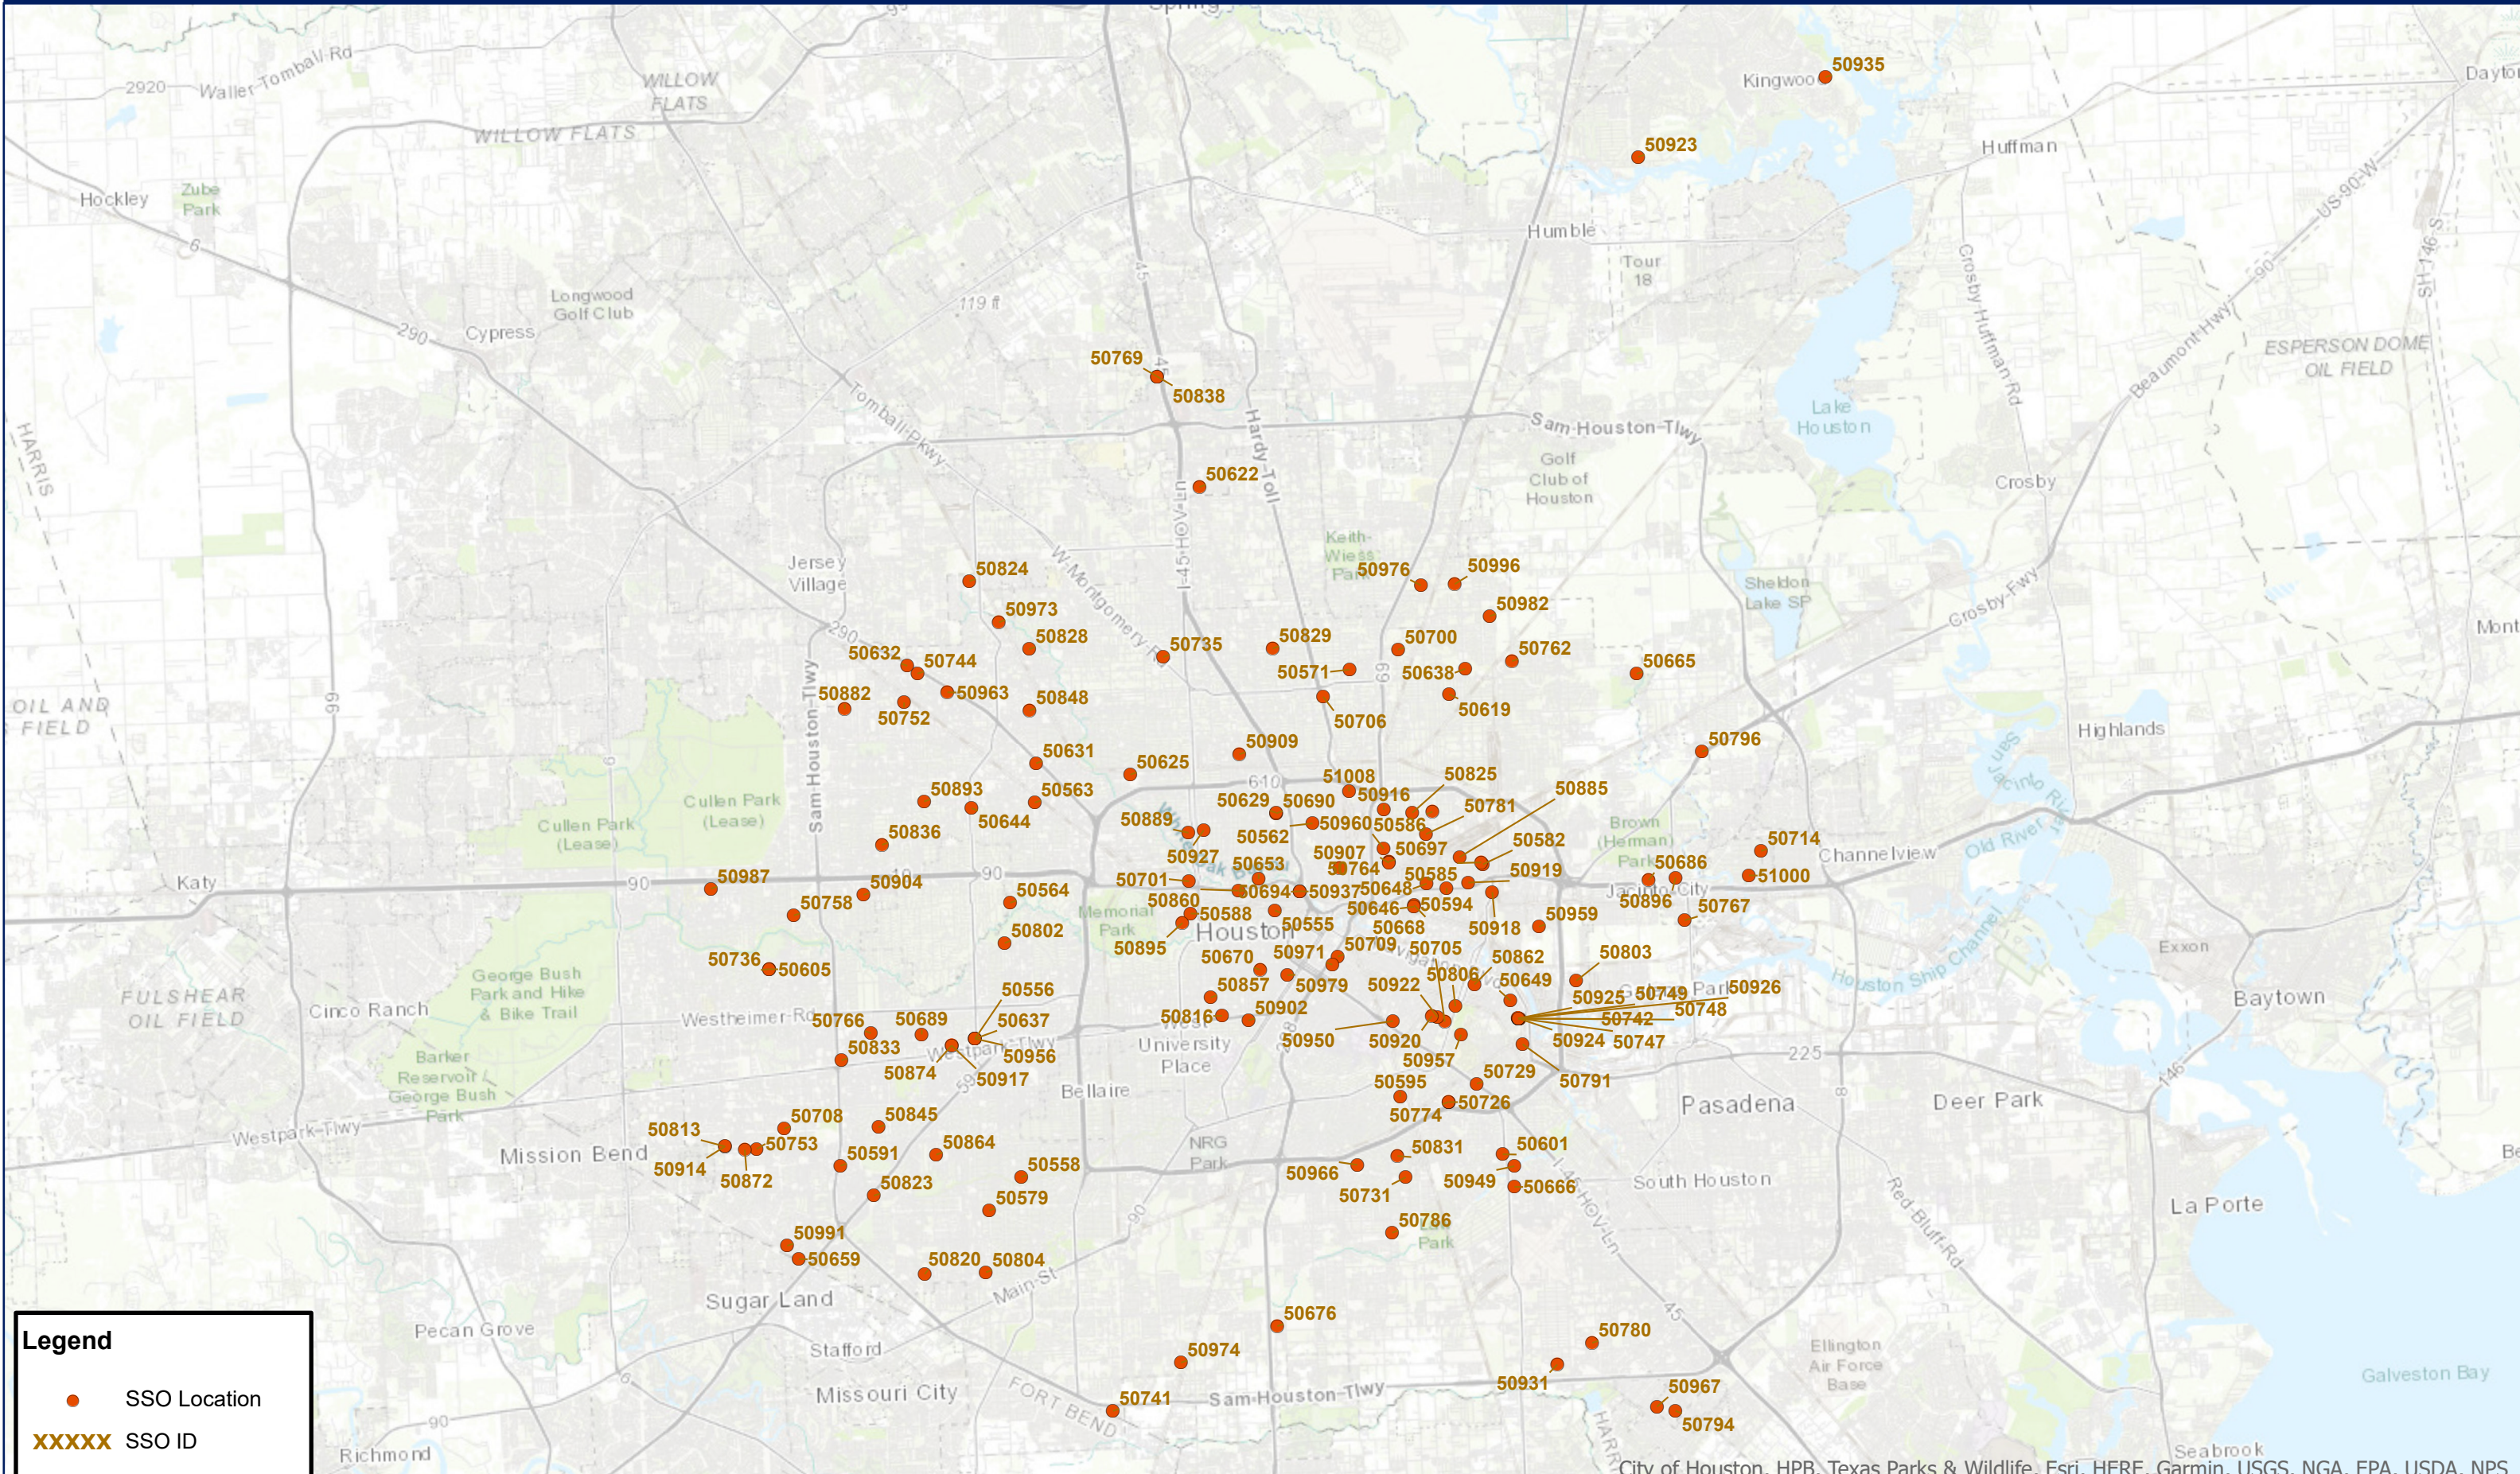

Legend

- SSO Location
- XXXXX SSO ID

Public SSO Map - January 2023



Geospatial or map data maintained by Houston Public Works is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and only represents the approximate location of property boundaries.

City of Houston, HPB, Texas Parks & Wildlife, Esri, HERE, Garmin, USGS, NGA, EPA, USDA, NPS

