



February 25, 2025

Associate Director, Water Enforcement
U.S. Environmental Protection Agency
Region VI
1201 Elm Street, Suite 500
Mail Code ECADW
Dallas, Texas 75270-2102

Via E-mail: Smalley.bryant@epa.gov

Re: City of Houston Wastewater Consent Decree
Civil Action No. 4:18-cv-03368
Monthly SSO Report – January 2025

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for January 2025 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Sincerely,

DocuSigned by:

Phillip Goodwin

Senior Assistant Director
Houston Public Works, City of Houston

Enc. January 2025 Monthly SSO Report; SSO Map for January 2025
cc via email: Thomas Carroll, DOJ (Thomas.Carroll@usdoj.gov)
James Zimny, EPA (Zimny.james@epa.gov)
Alan Vaughn, EPA (vaughn.alan@epa.gov)
Brittany Wright, Texas AG's Office (Brittany.Wright@oag.texas.gov)
James Sallans, TCEQ (james.sallans@tceq.texas.gov)
Kristen Schlemmer, BCWK (kristen@bayoucitywaterkeeper.org)



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61518	WQ0010495016	8154 RECORD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/1/2025	8:58	1/1/2025	8:59	0	Cleaned and Disinfected
61520	WQ0010495016	9129 LAKE FOREST BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/1/2025	10:17	1/1/2025	10:18	0	Cleaned and Disinfected; Cleared Service Lateral
61521	WQ0010495076	9014 LANDWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/1/2025	11:00	1/1/2025	11:01	0	Cleaned and Disinfected; Cleared Main Line
61522	WQ0010495076	2618 MAYVIEW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/1/2025	12:05	1/1/2025	12:06	0	Cleaned and Disinfected
61523	WQ0010495090	207 GRAY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/1/2025	13:55	1/1/2025	13:56	0	Cleared Main Line; Cleaned and Disinfected
61531	WQ0010495016	7413 LAURA KOPPE RD	Bayou/surface water/drainage ditch	Yes	81.5	City Cleanout	Rags/Wipes	1/2/2025	10:14	1/2/2025	12:57	0.5	Cleared Service Lateral; Cleaned and Disinfected
61532	WQ0010495002	7450 MAGNOLIA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/2/2025	10:02	1/2/2025	10:03	0	Cleared Service Lateral; Cleaned and Disinfected
61539	WQ0010495077	3918 HERALD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/2/2025	13:58	1/2/2025	13:59	0	Cleared Service Lateral; Cleaned and Disinfected
61540	WQ0010495023	7115 ELBERT ST	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Grease Blockage	1/2/2025	14:30	1/2/2025	14:31	0	Cleared Service Lateral; Cleaned and Disinfected
61541	WQ0010495076	7843 ANTOINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/2/2025	15:30	1/2/2025	15:31	0	Cleaned and Disinfected; Cleared City Clean Out
61549	WQ0010495090	1658 CASTLE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	52	Manhole	Grease Blockage	1/3/2025	10:07	1/3/2025	10:59	1	Cleared Main Line; Cleaned and Disinfected
61550	WQ0010495002	8014 GLENVIEW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/3/2025	8:39	1/3/2025	8:40	0	Cleaned and Disinfected
61555	WQ0010495002	5922 HONEYSUCKLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	293	City Cleanout	Collection system structural failure	1/3/2025	9:56	1/3/2025	14:49	1	Cleaned and Disinfected; Cleared City Clean Out; Set Bypass Pump
61559	WQ0010495076	8215 FAWNDALE LN	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Collection system structural failure	1/3/2025	11:25	1/3/2025	11:26	0	Cleaned and Disinfected
61560	WQ0010495009	5026 DUMORE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/3/2025	11:07	1/3/2025	11:08	0	Cleaned and Disinfected; Cleared City Clean Out
61562	WQ0010495016	7322 RHOBELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/3/2025	11:05	1/3/2025	11:06	0	Cleared Main Line; Cleaned and Disinfected
61567	WQ0010495116	126 HICKORY RIDGE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Roots	1/3/2025	15:31	1/3/2025	15:32	0	Cleaned and Disinfected; Cleared City Clean Out
61571	WQ0010495009	11314 BAY CEDAR DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/4/2025	8:57	1/4/2025	8:58	0	Cleaned and Disinfected
61572	WQ0010495090	7802 POINTER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/4/2025	9:55	1/4/2025	9:56	0	Cleared Main Line; Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61578	WQ0010495090	3802 COURTNEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/4/2025	14:35	1/4/2025	14:36	0	Cleaned and Disinfected
61598	WQ0010495003	1224 JACKSON BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural blockage	1/4/2025	15:05	1/4/2025	15:06	0	Cleaned and Disinfected
61607	WQ0010495090	738 LINK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/5/2025	10:30	1/5/2025	10:31	0	Cleared Service Lateral; Cleaned and Disinfected
61634	WQ0010495090	420 CAPLIN ST	Bayou/surface water/drainage ditch	Yes	51	Manhole	Grease Blockage	1/6/2025	9:52	1/6/2025	13:16	0.5	Cleaned and Disinfected; Cleared Main Line
61640	WQ0010495002	9631 AVENUE J	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/6/2025	12:00	1/6/2025	12:01	0	Cleaned and Disinfected; Cleared City Clean Out
61641	WQ0010495090	1517 NOBLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/6/2025	12:19	1/6/2025	12:20	0	Cleaned and Disinfected; Cleared Service Lateral
61642	WQ0010495002	5000 CALHOUN RD	Bayou/surface water/drainage ditch	Yes	4656	Gravity Main	Collection system structural failure	1/6/2025	13:38	1/7/2025	15:30	3	Cleaned and Disinfected; Set Bypass Pump; Post Warning Signs
61643	WQ0010495090	3307 HOUSTON AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/6/2025	13:45	1/6/2025	13:46	0	Cleared Service Lateral; Cleaned and Disinfected
61644	WQ0010495090	9716 EDGEWORTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/6/2025	13:33	1/6/2025	13:34	0	Cleared Service Lateral; Cleaned and Disinfected
61645	WQ0010495002	6321 BROOK LEA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/6/2025	13:54	1/6/2025	13:55	0	Cleared Service Lateral; Cleaned and Disinfected
61646	WQ0010495090	1519 NOBLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2154	City Cleanout	Grease Blockage	1/6/2025	14:11	1/7/2025	8:08	2	Cleared Service Lateral; Cleaned and Disinfected
61648	WQ0010495002	7540 BELLFORT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/6/2025	15:31	1/6/2025	15:32	0	Cleaned and Disinfected; Cleared Main Line
61651	WQ0010495090	62 SADDLEBROOK LN	Bayou/surface water/drainage ditch	Yes	0	Manhole	Collection system structural failure	1/6/2025	17:34	1/6/2025	17:35	0	Cleared Main Line; Cleaned and Disinfected
61652	WQ0010495037	7715 BANKSIDE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/7/2025	7:44	1/7/2025	7:45	0	Cleaned and Disinfected; Cleared Service Lateral
61657	WQ0010495077	12741 COULSON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Grease Blockage	1/7/2025	11:55	1/7/2025	11:56	0	Cleared Main Line; Cleaned and Disinfected
61658	WQ0010495037	10206 CLIFFWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/7/2025	13:40	1/7/2025	13:41	0	Cleared Service Lateral; Cleaned and Disinfected
61659	WQ0010495090	69 SADDLEBROOK LN	Bayou/surface water/drainage ditch	Yes	1257	Manhole	Grease Blockage	1/7/2025	14:29	1/8/2025	11:26	1	Cleaned and Disinfected
61660	WQ0010495037	5909 FONDREN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2832	Private Cleanout	Grease Blockage	1/7/2025	14:50	1/8/2025	14:26	2	Cleaned and Disinfected; Cleared Main Line
61661	WQ0010495016	7433 CLAIBORNE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/7/2025	14:35	1/7/2025	14:36	0	Cleaned and Disinfected; Cleared Main Line
61662	WQ0010495076	4026 BOLIN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1972	Manhole	Grease Blockage	1/7/2025	17:29	1/8/2025	9:55	2	Cleared Main Line; Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61664	WQ0010495090	535 PORTWALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	82	Manhole	Grease Blockage	1/7/2025	16:26	1/8/2025	13:51	0	Cleared Main Line; Cleaned and Disinfected
61667	WQ0010495002	3422 CULLEN BLVD	Storm Sewer (not contained)	Yes	26000	Manhole	Collection system structural failure	1/8/2025	9:12	1/8/2025	11:22	200	Cleaned and Disinfected; Post Warning Signs; Set Bypass Pump
61668	WQ0010495002	4226 MARTIN LUTHER KING BLVD	Storm Sewer (not contained)	Yes	1640	Manhole	Collection system structural failure	1/8/2025	8:38	1/8/2025	11:22	10	Set Bypass Pump; Cleaned and Disinfected; Post Warning Signs
61669	WQ0010495002	4250 MARTIN LUTHER KING BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	850	Manhole	Collection system structural failure	1/8/2025	9:57	1/8/2025	11:22	10	Set Bypass Pump; Cleaned and Disinfected; Post Warning Signs
61671	WQ0010495002	4361 COUGAR VILLAGE DR	Storm Sewer (not contained)	Yes	1125	Gravity Main	Collection system structural failure	1/8/2025	10:07	1/8/2025	11:22	15	Post Warning Signs; Cleaned and Disinfected; Set Bypass Pump
61672	WQ0010495016	9706 GUEST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/8/2025	9:17	1/8/2025	9:18	0	Cleaned and Disinfected; Set Bypass Pump
61674	WQ0010495002	3506 ELGIN ST	Storm Sewer (not contained)	Yes	0	Manhole	Collection system structural failure	1/8/2025	10:55	1/8/2025	10:56	0	Cleaned and Disinfected; Post Warning Signs; Set Bypass Pump
61676	WQ0010495002	3506 ELGIN ST	Storm Sewer (not contained)	Yes	0	Manhole	Collection system structural failure	1/8/2025	11:10	1/8/2025	11:10	0	Cleaned and Disinfected; Post Warning Signs; Set Bypass Pump
61679	WQ0010495090	2805 CHAPMAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/8/2025	11:32	1/8/2025	11:33	0	Cleaned and Disinfected; Cleared City Clean Out
61683	WQ0010495090	3702 LAURA KOPPE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/8/2025	13:27	1/8/2025	13:28	0	Cleaned and Disinfected; Set Bypass Pump
61691	WQ0010495037	6720 DE MOSS DR	Storm Sewer (not contained)	Yes	470	Manhole	Grease Blockage	1/9/2025	8:10	1/9/2025	12:05	2	Cleared Main Line; Cleaned and Disinfected
61694	WQ0010495090	4218 WIPPRECHT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/9/2025	11:13	1/9/2025	11:14	0	Cleared City Clean Out; Cleaned and Disinfected
61695	WQ0010495090	1111 PORTWALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/9/2025	10:51	1/9/2025	10:52	0	Cleared Service Lateral; Cleaned and Disinfected
61696	WQ0010495002	5133 MALMEDY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/9/2025	11:21	1/9/2025	11:22	0	Cleaned and Disinfected
61697	WQ0010495090	5615 LANDOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/9/2025	11:52	1/9/2025	11:53	0	Cleaned and Disinfected; Set Bypass Pump
61700	WQ0010495003	3135 DACCIA DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/9/2025	12:12	1/9/2025	12:13	0	Cleared Main Line; Cleaned and Disinfected
61703	WQ0010495009	5102 MADDEN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/9/2025	13:25	1/9/2025	13:26	0	Cleaned and Disinfected; Cleared Main Line
61710	WQ0010495002	4506 WHEELER ST	Storm Sewer (not contained)	Yes	625	Manhole	Collection system structural failure	1/8/2025	8:20	1/8/2025	10:25	5	Cleaned and Disinfected; Set Bypass Pump; Post Warning Signs
61713	WQ0010495016	7302 RHOBELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/10/2025	10:20	1/10/2025	10:21	0	Cleaned and Disinfected; Cleared Main Line

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61714	WQ0010495148	10015 VALLEY SUN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/10/2025	9:53	1/10/2025	9:54	0	Cleaned and Disinfected
61718	WQ0010495009	5123 MADDEN LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	732	Manhole	Grease Blockage	1/10/2025	10:15	1/10/2025	16:21	2	Cleaned and Disinfected; Cleared Main Line
61719	WQ0010495002	4617 KEYSTONE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/10/2025	10:51	1/10/2025	10:52	0	Cleared Main Line; Cleaned and Disinfected
61720	WQ0010495090	4207 ROGERS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/10/2025	11:35	1/10/2025	11:36	0	Cleaned and Disinfected
61722	WQ0010495003	13206 ADLER DR	Storm Sewer (not contained)	Yes	274	Manhole	Grease Blockage	1/10/2025	11:24	1/10/2025	13:41	2	Cleared Main Line; Cleaned and Disinfected
61724	WQ0010495099	7103 BAYOU FOREST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/10/2025	11:50	1/10/2025	11:51	0	Cleaned and Disinfected; Cleared Main Line
61725	WQ0010495037	7360 RAMPART ST	Storm Sewer (not contained)	Yes	450	Manhole	Grease Blockage	1/10/2025	12:45	1/10/2025	16:30	2	Cleared Main Line; Cleaned and Disinfected
61726	WQ0010495111	10500 BELLAIRE BLVD	Storm Sewer (not contained)	Yes	645	Manhole	WWTP Instrumentation Failure	1/10/2025	12:44	1/10/2025	16:19	3	Cleared Main Line; Cleaned and Disinfected; Set Bypass Pump
61728	WQ0010495111	10005 BEECHNUT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	WWTP Instrumentation Failure	1/10/2025	8:27	1/10/2025	8:28	0	Set Bypass Pump; Cleaned and Disinfected
61729	WQ0010495090	5320 EAST FWY	Storm Sewer (not contained)	Yes	3260	City Cleanout	Rags/Wipes	1/11/2025	10:15	1/12/2025	13:25	2	Cleared City Clean Out; Cleaned and Disinfected
61730	WQ0010495016	5414 EASTLAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/11/2025	11:19	1/11/2025	11:20	0	Cleared City Clean Out; Cleaned and Disinfected
61734	WQ0010495016	8633 KELLETT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/12/2025	8:30	1/12/2025	8:31	0	Cleaned and Disinfected; Cleared Service Lateral
61739	WQ0010495002	6651 MYRTLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/12/2025	10:55	1/12/2025	10:56	0	Cleaned and Disinfected
61740	WQ0010495111	10080 BELLAIRE BLVD	Storm Sewer (not contained)	Yes	2050	Manhole	WWTP Instrumentation Failure	1/10/2025	12:44	1/10/2025	16:19	10	Cleaned and Disinfected; Set Bypass Pump; Post Warning Signs
61747	WQ0010495148	10006 VALLEY SUN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/13/2025	10:30	1/13/2025	10:31	0	Cleared Service Lateral; Cleaned and Disinfected
61748	WQ0010495090	1221 BLALOCK RD	Storm Sewer - contained	Yes	0	Private Cleanout	Collection system structural failure	1/13/2025	13:45	1/13/2025	13:46	0	Set Bypass Pump; Cleaned and Disinfected
61749	WQ0010495090	1545 BIRDSALL ST	Storm Sewer - contained	Yes	0	Service Lateral	Rags/Wipes	1/13/2025	11:40	1/13/2025	11:41	0	Cleared Main Line; Cleaned and Disinfected
61755	WQ0010495002	3852 TELEPHONE RD	Storm Sewer (not contained)	Yes	918	Manhole	Grease Blockage	1/14/2025	8:00	1/14/2025	15:39	2	Cleaned and Disinfected; Cleared Main Line
61756	WQ0010495119	8002 GESSNER RD	Storm Sewer (not contained)	Yes	0	Private Cleanout	Grease Blockage	1/14/2025	8:10	1/14/2025	8:11	0	Cleaned and Disinfected; Cleared City Clean Out
61757	WQ0010495090	6524 EAGLE PASS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/14/2025	10:19	1/14/2025	10:20	0	Cleaned and Disinfected; Set Bypass Pump
61758	WQ0010495090	3430 EASY ST	Bayou/surface water/drainage ditch	Yes	3488	City Cleanout	Collection system structural failure	1/14/2025	10:45	1/15/2025	15:49	2	Cleaned and Disinfected
61759	WQ0010495037	9018 PETERSHAM DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	1/14/2025	11:26	1/14/2025	11:27	0	Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61760	WQ0010495002	1222 THERESA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	1/14/2025	10:10	1/14/2025	10:11	0	Cleaned and Disinfected
61764	WQ0010495110	6003 QUIET VILLAGE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/14/2025	11:58	1/14/2025	11:59	0	Cleared Main Line; Cleaned and Disinfected
61767	WQ0010495090	1511 WIPPRECHT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/14/2025	13:06	1/14/2025	13:07	0	Cleared City Clean Out; Cleaned and Disinfected
61776	WQ0010495003	5119 KNOTTY OAKS TRL	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/14/2025	11:25	1/14/2025	11:26	0	Cleaned and Disinfected
61777	WQ0010495090	1111 PORTWALL ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	1/14/2025	16:42	1/14/2025	16:43	0	Cleared City Clean Out; Cleaned and Disinfected
61778	WQ0010495030	2203 GESSNER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/14/2025	16:58	1/14/2025	16:59	0	Cleared Service Lateral; Cleaned and Disinfected
61780	WQ0010495002	3852 TELEPHONE RD	Storm Sewer (not contained)	Yes	634	Manhole	Grease Blockage	1/15/2025	8:06	1/15/2025	13:23	2	Cleared Main Line; Cleaned and Disinfected
61781	WQ0010495090	615 15TH	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/15/2025	8:30	1/15/2025	8:31	0	Cleaned and Disinfected; Set Bypass Pump
61782	WQ0010495090	1545 BIRDSALL ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Collection system structural failure	1/15/2025	9:00	1/15/2025	9:01	0	Cleaned and Disinfected
61783	WQ0010495090	4802 HARDY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/15/2025	10:21	1/15/2025	10:22	0	Cleaned and Disinfected; Cleared City Clean Out
61785	WQ0010495146	3930 HIDDEN GLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/15/2025	10:23	1/15/2025	10:24	0	Cleaned and Disinfected
61786	WQ0010495077	13218 ROCKGLEN ST	Bayou/surface water/drainage ditch	Yes	778	City Cleanout	Rags/Wipes	1/15/2025	11:48	1/15/2025	18:17	2	Cleared City Clean Out; Cleaned and Disinfected
61788	WQ0010495146	2145 NORTH PARK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/15/2025	12:26	1/15/2025	12:27	0	Cleaned and Disinfected; Cleared Service Lateral
61789	WQ0010495090	10617 EXETER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Rags/Wipes	1/15/2025	15:06	1/15/2025	15:07	0	Cleared Service Lateral; Cleaned and Disinfected
61790	WQ0010495090	1315 BLALOCK RD	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural failure	1/15/2025	15:39	1/15/2025	15:40	0	Cleaned and Disinfected; Set Bypass Pump
61794	WQ0010495090	6910 PETRE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/16/2025	9:52	1/16/2025	9:52	0	Cleaned and Disinfected; Cleared Service Lateral
61800	WQ0010495037	6601 DUNLAP ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	760	Manhole	Grease Blockage	1/16/2025	12:10	1/16/2025	18:30	2	Cleared Main Line; Cleaned and Disinfected
61803	WQ0010495090	2103 DAVIS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/16/2025	14:29	1/16/2025	14:30	0	Cleaned and Disinfected; Cleared City Clean Out
61805	WQ0010495016	8134 LAURA KOPPE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/16/2025	15:47	1/16/2025	15:48	0	Cleaned and Disinfected
61808	WQ0010495111	10907 LANGDON LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/17/2025	7:41	1/17/2025	7:42	0	Cleared Main Line; Cleaned and Disinfected
61811	WQ0010495090	2000 BAGBY ST	Storm Sewer (not contained)	Yes	274	Private Cleanout	Grease Blockage	1/17/2025	10:24	1/17/2025	12:41	2	Cleaned and Disinfected; Cleared Main Line

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61812	WQ0010495003	4106 MOWERY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/17/2025	10:06	1/17/2025	10:07	0	Cleaned and Disinfected
61820	WQ0010495002	3930 WARD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/17/2025	14:17	1/17/2025	14:18	0	Cleaned and Disinfected; Cleared City Clean Out
61821	WQ0010495119	8002 GESSNER RD	Storm Sewer (not contained)	Yes	1130	Private Cleanout	Grease Blockage	1/17/2025	15:10	1/18/2025	10:00	1	Cleared Service Lateral; Cleaned and Disinfected
61823	WQ0010495076	5102 ANTOINE DR	Storm Sewer (not contained)	Yes	132	Manhole	Grease Blockage	1/17/2025	18:00	1/17/2025	19:06	2	Cleared Main Line; Cleaned and Disinfected
61824	WQ0010495075	11700 SAGEARBOR DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Force Main	Collection system structural failure	1/17/2025	18:00	1/17/2025	18:01	0	Contain All or Portion of Spill; Returned Spill to Sanitary System
61825	WQ0010495002	7322 JUTLAND RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/18/2025	9:15	1/18/2025	9:16	0	Cleared Main Line; Cleaned and Disinfected
61826	WQ0010495090	7118 TUCK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/18/2025	10:18	1/18/2025	10:19	0	Cleaned and Disinfected; Cleared Main Line
61827	WQ0010495009	4228 ROCKINGHAM ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/18/2025	9:54	1/18/2025	9:55	0	Cleared Main Line; Cleaned and Disinfected
61832	WQ0010495150	12418 BIG OAKS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/18/2025	13:25	1/18/2025	13:26	0	Cleaned and Disinfected; Cleared Main Line; Cleared Service Lateral
61834	WQ0010495090	8802 MANUS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/18/2025	15:04	1/18/2025	15:05	0	Cleaned and Disinfected; Cleared City Clean Out
61837	WQ0010495016	6322 ROSEMARY LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/19/2025	9:40	1/19/2025	9:41	0	Cleared Main Line; Cleaned and Disinfected
61844	WQ0010495090	5320 EAST FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	935	Private Cleanout	Collection system structural failure	1/19/2025	12:58	1/19/2025	16:05	5	Cleaned and Disinfected; Cleared Service Lateral
61845	WQ0010495037	10841 GREENWILLOW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	4528	Manhole	Grease Blockage	1/18/2025	7:45	1/19/2025	13:56	3	Cleaned and Disinfected; Cleared Main Line
61848	WQ0010495090	8826 GLENHOUSE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1378	Manhole	Grease Blockage	1/19/2025	13:57	1/20/2025	12:55	1	Cleaned and Disinfected; Cleared Main Line
61851	WQ0010495090	4136 CASTOR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/20/2025	8:25	1/20/2025	8:26	0	Cleaned and Disinfected
61853	WQ0010495003	1701 COMMONWEALTH ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	1/20/2025	9:26	1/20/2025	9:27	0	Cleared City Clean Out; Cleaned and Disinfected
61855	WQ0010495099	7142 YELLOW PINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/20/2025	10:50	1/20/2025	10:51	0	Cleaned and Disinfected; Cleared Main Line
61856	WQ0010495090	7413 AIRLINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	28311	Manhole	Collection system structural blockage	1/20/2025	11:00	1/23/2025	22:47	6	Cleaned and Disinfected
61858	WQ0010495090	1413 COPELAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	1/20/2025	13:07	1/20/2025	13:08	0	Cleaned and Disinfected
61862	WQ0010495090	4115 LILLIAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/20/2025	15:32	1/20/2025	15:33	0	Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61863	WQ0010495099	7202 YELLOW PINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/20/2025	11:25	1/20/2025	11:26	0	Cleaned and Disinfected; Cleared Main Line
61866	WQ0010495037	6371 RICHMOND AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/22/2025	9:41	1/22/2025	9:42	0	Cleared City Clean Out; Cleaned and Disinfected
61867	WQ0010495090	211 MELBOURNE ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	City Cleanout	Rags/Wipes	1/22/2025	12:28	1/22/2025	12:29	0	Cleaned and Disinfected; Cleared City Clean Out
61868	WQ0010495090	1402 NOBLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/22/2025	13:45	1/22/2025	13:46	0	Cleaned and Disinfected
61869	WQ0010495090	2706 ELYSIAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/22/2025	13:51	1/22/2025	13:52	0	Cleared City Clean Out; Cleaned and Disinfected
61872	WQ0010495090	810 MILWAUKEE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	12772	Manhole	Grease Blockage	1/23/2025	8:18	1/25/2025	14:05	4	Cleared Main Line; Cleaned and Disinfected
61874	WQ0010495090	8743 CANDY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/23/2025	8:54	1/23/2025	8:55	0	Cleaned and Disinfected
61876	WQ0010495090	8826 GLENHOUSE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	854	Manhole	Grease Blockage	1/23/2025	9:15	1/23/2025	16:22	2	Cleared Main Line; Cleaned and Disinfected
61877	WQ0010495116	7979 WESTHEIMER RD	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural failure	1/23/2025	9:32	1/23/2025	9:33	0	Cleaned and Disinfected
61879	WQ0010495090	8509 LAVENDER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/23/2025	9:39	1/23/2025	9:40	0	Cleaned and Disinfected; Cleared Main Line
61883	WQ0010495077	12607 KATHRYN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/23/2025	10:46	1/23/2025	10:47	0	Cleared City Clean Out; Cleaned and Disinfected
61884	WQ0010495002	2816 PALM ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/23/2025	11:03	1/23/2025	11:04	0	Cleared City Clean Out; Cleaned and Disinfected
61885	WQ0010495109	603 THISTLEWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/23/2025	11:19	1/23/2025	11:20	0	Cleaned and Disinfected
61886	WQ0010495002	8044 WIER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	3524	Manhole	Rags/Wipes	1/23/2025	10:35	1/24/2025	15:57	2	Cleared Main Line; Cleaned and Disinfected
61889	WQ0010495090	307 ADAMS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1165	City Cleanout	Rags/Wipes	1/23/2025	11:40	1/23/2025	15:33	5	Cleared City Clean Out; Cleaned and Disinfected
61890	WQ0010495090	305 16TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/23/2025	11:55	1/23/2025	11:56	0	Cleared Service Lateral; Cleaned and Disinfected
61891	WQ0010495009	13215 FOXTON RD	Bayou/surface water/drainage ditch	Yes	1022	Force Main	Collection system structural failure	1/23/2025	10:45	1/24/2025	12:00	1	Cleaned and Disinfected
61898	WQ0010495090	7431 AVENUE L	Storm Sewer (not contained)	Yes	486	City Cleanout	Rags/Wipes	1/23/2025	14:51	1/23/2025	18:54	2	Cleaned and Disinfected; Cleared City Clean Out
61900	WQ0010495148	10006 VALLEY SUN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/23/2025	17:35	1/23/2025	17:36	0	Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61901	#N/A	9514 GALVESTON RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2350	Private Sample Well	Collection system structural failure	1/23/2025	15:15	1/24/2025	10:50	2	Cleaned and Disinfected
61908	WQ0010495003	3101 RICHMOND AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/24/2025	9:04	1/24/2025	9:05	0	Cleared Service Lateral; Cleaned and Disinfected
61911	WQ0010495111	12320 BELLAIRE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/24/2025	10:22	1/24/2025	10:23	0	Cleared City Clean Out; Cleaned and Disinfected
61912	WQ0010495090	6925 AVENUE Q	Bayou/surface water/drainage ditch	Yes	1591	City Cleanout	Grease Blockage	1/24/2025	11:30	1/25/2025	14:01	1	Cleaned and Disinfected; Cleared City Clean Out
61913	WQ0010495090	1003 WAKEFIELD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	1/24/2025	11:45	1/24/2025	11:46	0	Cleaned and Disinfected; Cleared Main Line
61920	WQ0010495109	12007 WEDGEHILL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	1/24/2025	11:56	1/24/2025	11:57	0	Cleaned and Disinfected; Set Bypass Pump
61922	WQ0010495002	7431 MAGNOLIA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/24/2025	13:51	1/24/2025	13:52	0	Cleaned and Disinfected
61927	WQ0010495050	815 SULPHUR ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/24/2025	14:40	1/24/2025	14:41	0	Cleaned and Disinfected; Cleared City Clean Out
61931	WQ0010495090	317 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/25/2025	9:22	1/25/2025	9:23	0	Cleared Service Lateral; Cleaned and Disinfected
61939	WQ0010495037	10509 WILLOWGROVE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	119	Manhole	Grease Blockage	1/25/2025	13:01	1/25/2025	15:00	1	Cleared Main Line; Cleaned and Disinfected
61940	WQ0010495090	4002 LOCKWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system temporary blockage	1/25/2025	13:55	1/25/2025	13:56	0	Cleaned and Disinfected
61941	WQ0010495076	2111 WAVELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/25/2025	13:39	1/25/2025	13:40	0	Cleared Service Lateral; Cleaned and Disinfected
61944	WQ0010495090	6925 AVENUE Q	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	1/26/2025	8:58	1/26/2025	8:59	0	Cleaned and Disinfected
61947	WQ0010495110	5111 RIDGESTONE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/26/2025	9:28	1/26/2025	9:29	0	Cleaned and Disinfected; Cleared City Clean Out
61948	WQ0010495119	9211 CARVEL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/26/2025	10:07	1/26/2025	10:08	0	Cleared Service Lateral; Cleaned and Disinfected
61951	WQ0010495009	5408 GROVETON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/26/2025	14:26	1/26/2025	14:27	0	Cleaned and Disinfected; Cleared Service Lateral
61953	WQ0010495111	6807 TURTLEWOOD DR	Storm Sewer (not contained)	Yes	16600	Manhole	WWTP Instrumentation Failure	1/26/2025	19:56	1/27/2025	4:00	34	Cleaned and Disinfected; Post Warning Signs; Set Bypass Pump
61954	WQ0010495111	10202 BELLAIRE BLVD	Storm Sewer (not contained)	Yes	5370	Manhole	WWTP Instrumentation Failure	1/26/2025	21:15	1/27/2025	4:00	13	Post Warning Signs; Cleaned and Disinfected; Set Bypass Pump
61959	WQ0010495090	1301 WAYSIDE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system - wet weather	1/26/2025	18:44	1/26/2025	18:45	0	Cleaned and Disinfected
61961	WQ0010495090	960 KIRBY DR	Storm Sewer (not contained)	Yes	342	Manhole	Grease Blockage	1/27/2025	10:07	1/27/2025	15:49	1	Cleaned and Disinfected; Cleared Main Line

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61962	WQ0010495002	3222 SIMMONS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/27/2025	9:37	1/27/2025	9:38	0	Cleared Main Line; Cleaned and Disinfected
61963	WQ0010495003	5422 HEATHERCREST ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/27/2025	10:07	1/27/2025	10:08	0	Cleaned and Disinfected
61965	WQ0010495090	8526 WIGGINS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/27/2025	11:05	1/27/2025	11:06	0	Cleared Main Line; Cleaned and Disinfected
61966	WQ0010495119	11700 WESTHEIMER RD	Storm Sewer (not contained)	Yes	282	Manhole	Grease Blockage	1/27/2025	12:15	1/27/2025	13:49	3	Cleaned and Disinfected; Cleared Main Line
61967	WQ0010495002	4450 MACGREGOR WAY	Storm Sewer (not contained)	Yes	171	Manhole	Grease Blockage	1/27/2025	13:01	1/27/2025	15:52	1	Cleaned and Disinfected; Cleared Main Line
61968	WQ0010495077	3611 MANITOU DR	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	1/27/2025	12:46	1/27/2025	12:47	0	Cleared Service Lateral; Cleaned and Disinfected
61969	WQ0010495111	11130 MEADOWGLEN LN	Storm Sewer (not contained)	Yes	1014	Manhole	Grease Blockage	1/27/2025	13:10	1/27/2025	16:49	5	Cleaned and Disinfected; Cleared Main Line
61971	WQ0010495037	7127 CARVEL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/27/2025	13:15	1/27/2025	13:16	0	Cleared Service Lateral; Cleaned and Disinfected
61972	WQ0010495122	6910 OLD NORTH BELT PKWY	Storm Sewer (not contained)	Yes	9864	Manhole	Grease Blockage	1/27/2025	14:04	1/28/2025	10:37	8	Cleared Main Line; Cleaned and Disinfected
61976	WQ0010495002	8424 LENORE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/27/2025	16:34	1/27/2025	16:35	0	Cleaned and Disinfected; Set Bypass Pump
61977	WQ0010495090	921 WOODARD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/28/2025	7:37	1/28/2025	7:38	0	Cleaned and Disinfected; Cleared Service Lateral
61978	WQ0010495002	4734 WOODSIDE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/28/2025	8:06	1/28/2025	8:07	0	Cleared Main Line; Cleaned and Disinfected
61980	WQ0010495119	7219 TANAGER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/28/2025	8:02	1/28/2025	8:03	0	Cleared Main Line; Cleaned and Disinfected
61982	WQ0010495090	8516 LANEWOOD DR	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Collection system temporary blockage	1/28/2025	10:39	1/28/2025	10:40	0	Cleared Service Lateral; Cleaned and Disinfected; Cleared Main Line
61987	WQ0010495002	8424 BROCKTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/28/2025	10:42	1/28/2025	10:43	0	Cleared City Clean Out
61989	WQ0010495002	7033 KINNEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/28/2025	11:01	1/28/2025	11:02	0	Cleaned and Disinfected; Cleared Service Lateral
61990	WQ0010495090	5612 MAY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/30/2025	12:20	1/30/2025	12:21	0	Cleared City Clean Out; Cleaned and Disinfected
61991	WQ0010495050	2323 THETA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system temporary blockage	1/28/2025	10:50	1/28/2025	10:51	0	Cleaned and Disinfected
61993	WQ0010495110	6023 IRISH HILL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system - wet weather	1/28/2025	11:26	1/28/2025	11:27	0	Cleaned and Disinfected
61994	WQ0010495002	7711 GLENVISTA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/28/2025	11:37	1/28/2025	11:38	0	Cleared Main Line; Cleaned and Disinfected
61995	WQ0010495077	12813 COULSON ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	1/29/2025	11:23	1/29/2025	11:24	0	Cleared City Clean Out; Cleaned and Disinfected
61998	WQ0010495002	8730 GULF FWY	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	1/28/2025	13:30	1/28/2025	13:31	0	Cleaned and Disinfected; Cleared City Clean Out

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
62000	WQ0010495075	11414 SAGEDOWNE LN	Storm Sewer (not contained)	Yes	0	Manhole	Collection system – wet weather	1/26/2025	13:35	1/26/2025	13:36	0	Cleaned and Disinfected
62001	WQ0010495016	8906 LEYCREST RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/28/2025	14:11	1/28/2025	14:12	0	Cleared City Clean Out; Cleaned and Disinfected
62002	WQ0010495003	3453 INWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	1/28/2025	14:39	1/28/2025	14:40	0	Cleaned and Disinfected; Cleared City Clean Out
62004	WQ0010495009	7315 BASTOGNE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	1/28/2025	15:11	1/28/2025	15:12	0	Cleared Main Line; Contain All or Portion of Spill
62007	WQ0010495065	9902 GULF FWY	Storm Sewer - contained	Yes	0	Private Cleanout	Grease Blockage	1/28/2025	16:22	1/28/2025	16:23	0	Cleaned and Disinfected; Cleared Main Line
62008	WQ0010495002	6306 BELLFORT ST	Storm Sewer (not contained)	Yes	1431	Private Cleanout	Grease Blockage	1/28/2025	18:19	1/29/2025	18:10	1	Cleared Main Line; Cleaned and Disinfected
62009	WQ0010495016	6310 HOPPER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/29/2025	8:55	1/29/2025	8:56	0	Cleared Service Lateral; Cleaned and Disinfected
62010	WQ0010495037	6768 RENWICK DR	Storm Sewer (not contained)	Yes	0	City Cleanout	Grease Blockage	1/29/2025	9:10	1/29/2025	9:11	0	Cleared Main Line; Cleaned and Disinfected
62011	WQ0010495090	1922 RIDGEMORE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	1/29/2025	9:47	1/29/2025	9:48	0	Cleaned and Disinfected
62014	WQ0010495009	4141 BARBERRY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/29/2025	9:59	1/29/2025	10:00	0	Cleared Main Line; Cleaned and Disinfected
62017	WQ0010495009	5710 PEACOCK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/29/2025	10:25	1/29/2025	10:26	0	Cleaned and Disinfected; Cleared Service Lateral
62018	WQ0010495090	5611 CRANE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/29/2025	10:11	1/29/2025	10:12	0	Cleaned and Disinfected
62021	WQ0010495111	12320 BELLAIRE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/29/2025	12:19	1/29/2025	12:20	0	Cleared City Clean Out; Cleaned and Disinfected
62022	WQ0010495090	9602 PANOLA WAY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/29/2025	14:01	1/29/2025	14:02	0	Cleared Main Line; Cleaned and Disinfected
62027	WQ0010495010	9301 CLINTON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	160	Manhole	Grease Blockage	1/29/2025	14:58	1/29/2025	15:30	5	Cleared Main Line; Cleaned and Disinfected
62030	WQ0010495002	3142 GOLFCREST BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/29/2025	15:08	1/29/2025	15:09	0	Cleaned and Disinfected; Cleared Main Line
62032	WQ0010495090	1520 GELLHORN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2220	Manhole	Grease Blockage	1/29/2025	17:04	1/30/2025	11:34	2	Cleared Main Line; Cleaned and Disinfected
62036	WQ0010495002	1522 COLLIER ST	Storm Sewer (not contained)	Yes	3310	Manhole	Collection system structural failure	1/30/2025	9:40	2/1/2025	16:50	1	Set Bypass Pump; Cleaned and Disinfected
62039	WQ0010495023	8021 FILLTOP ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/30/2025	10:33	1/30/2025	10:34	0	Cleared Service Lateral; Cleaned and Disinfected
62040	WQ0010495090	314 CANINO RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/30/2025	10:11	1/30/2025	10:12	0	Set Bypass Pump; Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
62042	WQ0010495090	3201 LAURA KOPPE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	62	Private Cleanout	Rags/Wipes	1/31/2025	11:39	1/31/2025	12:10	2	Cleared Service Lateral; Cleaned and Disinfected
62043	WQ0010495090	810 BOLLING LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	5694	Private Cleanout	Rags/Wipes	1/30/2025	13:56	2/3/2025	12:50	1	Cleaned and Disinfected; Cleared Service Lateral
62044	WQ0010495146	2145 NORTH PARK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/30/2025	12:55	1/30/2025	12:56	0	Cleaned and Disinfected
62048	WQ0010495002	7030 EASTWOOD ST	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	1/30/2025	16:32	1/30/2025	16:33	0	Cleared Main Line; Cleaned and Disinfected
62049	WQ0010495090	3906 ENGLEWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	1/30/2025	16:41	1/30/2025	16:42	0	Cleared Main Line; Cleaned and Disinfected
62050	WQ0010495090	1111 PORTWALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2872	City Cleanout	Grease Blockage	1/30/2025	17:17	1/31/2025	17:13	2	Cleaned and Disinfected; Cleared Main Line
62055	WQ0010495016	7417 BIGWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/31/2025	9:36	1/31/2025	9:37	0	Cleaned and Disinfected
62056	WQ0010495119	10606 AMBLEWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	1/31/2025	9:28	1/31/2025	9:29	0	Cleared Main Line; Cleaned and Disinfected
62058	WQ0010495090	4106 CORTO ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/31/2025	11:00	1/31/2025	11:01	0	Cleaned and Disinfected
62060	WQ0010495010	9326 RHODE ISLAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	1/31/2025	11:42	1/31/2025	11:43	0	Cleaned and Disinfected


Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
 Monthly SSO Report
 January 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
62061	WQ0010495076	3838 VILLA GLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/31/2025	11:32	1/31/2025	11:33	0	Cleared City Clean Out; Cleaned and Disinfected
62065	WQ0010495003	3516 SHEPHERD DR	Storm Sewer (not contained)	Yes	312	City Cleanout	Rags/Wipes	1/31/2025	14:25	1/31/2025	17:01	2	Cleaned and Disinfected; Cleared Main Line
62066	WQ0010495016	8623 ELBERT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system temporary blockage	1/31/2025	15:06	1/31/2025	15:07	0	Cleared Service Lateral; Cleaned and Disinfected
62072	WQ0010495090	3026 BERRY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	1/31/2025	15:49	1/31/2025	15:49	0	Cleaned and Disinfected; Cleared Service Lateral
62075	WQ0010495016	10317 BAINBRIDGE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	1/31/2025	16:51	1/31/2025	16:52	0	Cleared Service Lateral; Cleaned and Disinfected
62077	WQ0010495002	3720 LEELEND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1078	Private Cleanout	Rags/Wipes	1/31/2025	18:17	2/1/2025	12:15	1	Cleared Service Lateral; Cleaned and Disinfected
62078	WQ0010495111	6515 ROGERDALE RD	Storm Sewer (not contained)	Yes	1197	Manhole	Grease Blockage	1/31/2025	18:24	2/1/2025	14:21	1	Cleared Main Line; Cleaned and Disinfected

Total Number of SSOs:	219
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

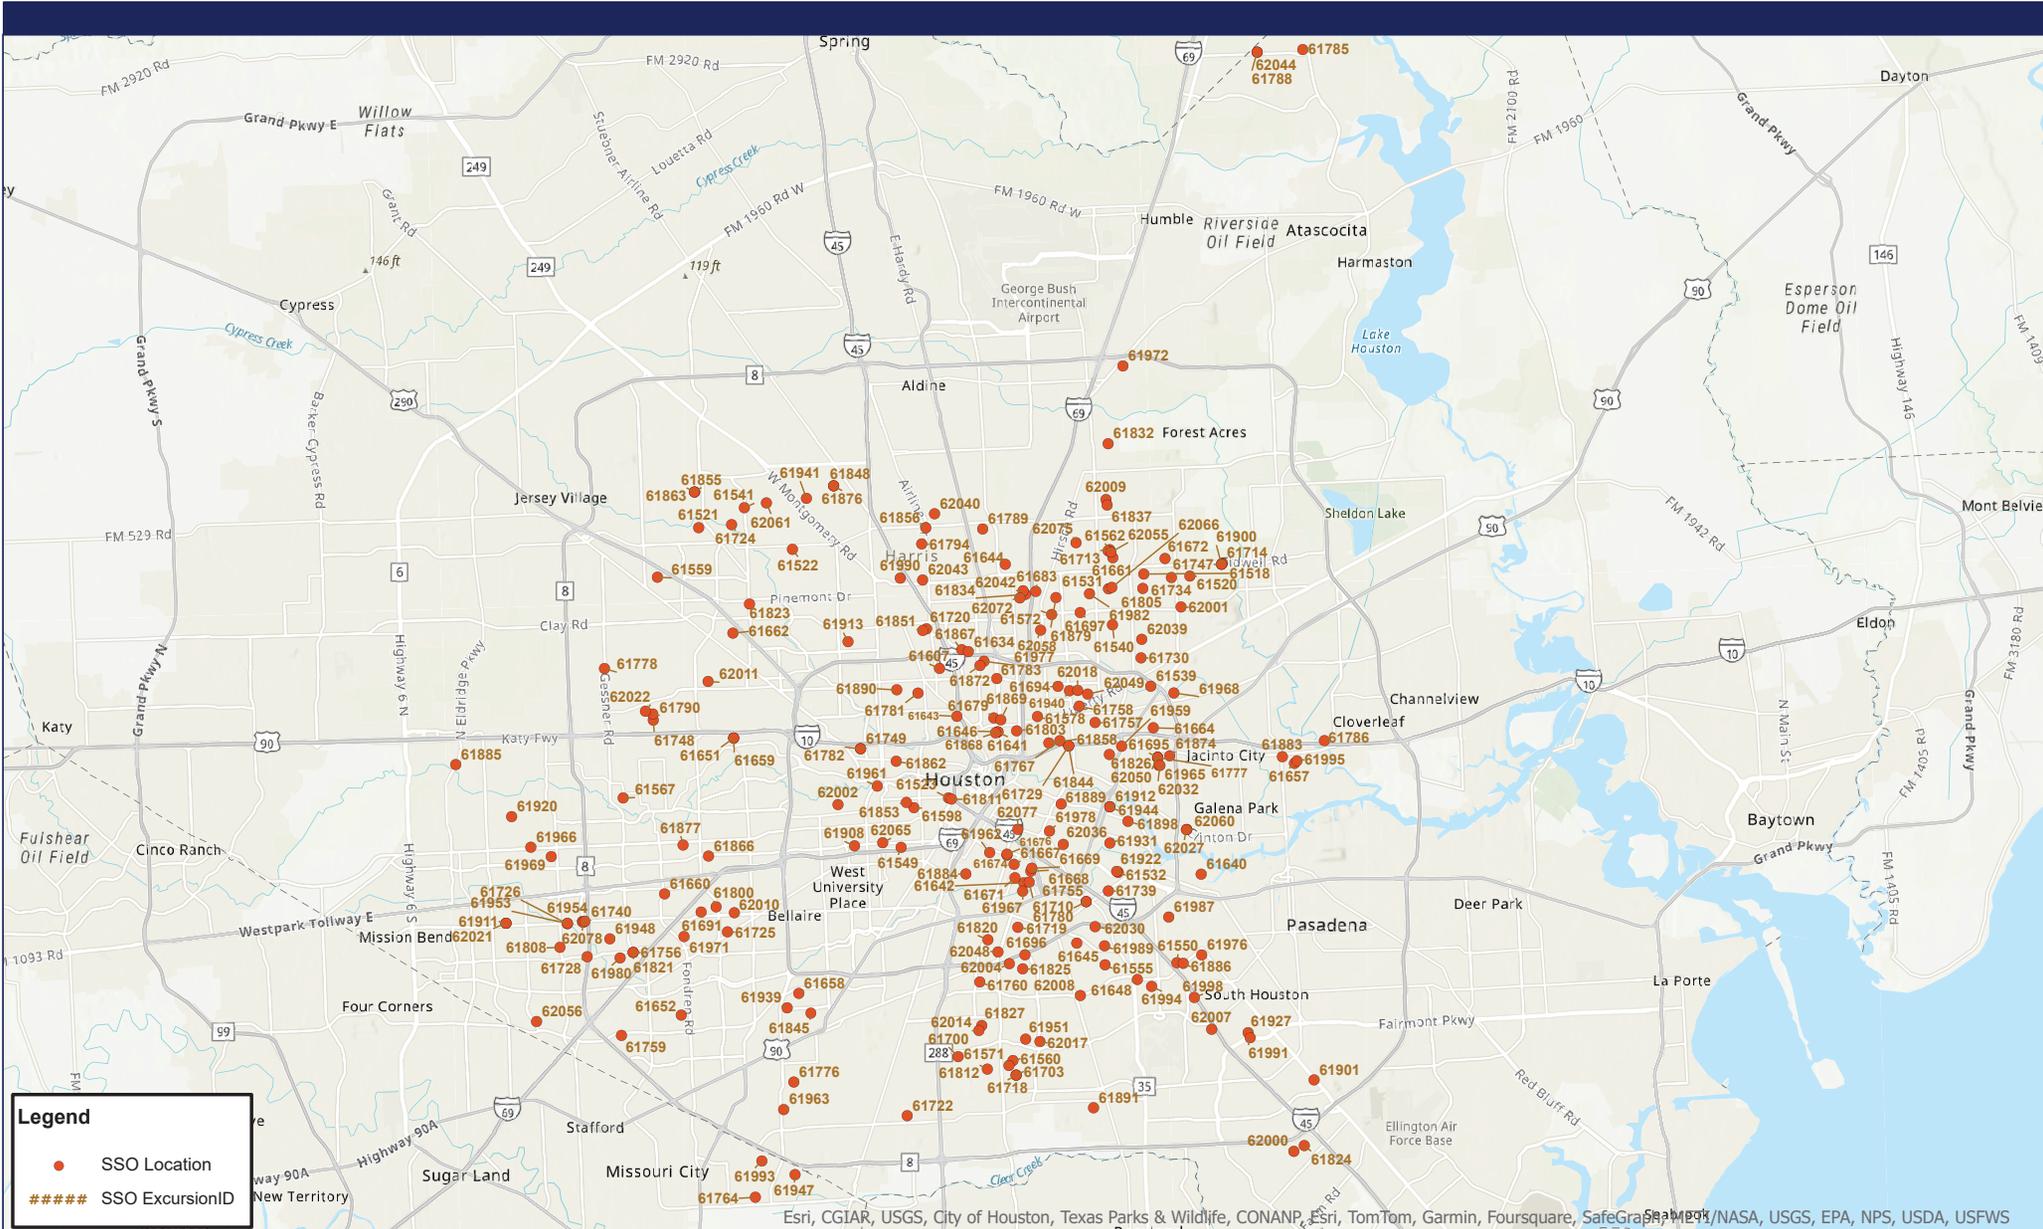

Legend

- SSO Location
- ##### SSO ExcursionID

Esri, CGIAR, USGS, City of Houston, Texas Parks & Wildlife, CONANP, Esri, TomTom, Garmin, Foursquare, SafeGraph, HERE, NASA, USGS, EPA, NPS, USDA, USFWS



Geospatial or map data maintained by Houston Public Works is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and only represents the approximate location of property boundaries.

Public SSO Map - January 2025

