



July 21, 2025

Associate Director, Water Enforcement
U.S. Environmental Protection Agency
Region VI
1201 Elm Street, Suite 500
Mail Code ECADW
Dallas, Texas 75270-2102

Via E-mail: Smalley.bryant@epa.gov

Re: City of Houston Wastewater Consent Decree
Civil Action No. 4:18-cv-03368
Monthly SSO Report – June 2025

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for June 2025 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Sincerely,


DocuSigned by:
Phillip Goodwin
09B3519C2807428...

Senior Assistant Director
Houston Public Works, City of Houston

Enc. June 2025 Monthly SSO Report; SSO Map for June 2025
cc via email: Thomas Carroll, DOJ (Thomas.Carroll@usdoj.gov)
James Zimny, EPA (Zimny.james@epa.gov)
Alan Vaughn, EPA (vaughn.alan@epa.gov)
Brittany Wright, Texas AG's Office (Brittany.Wright@oag.texas.gov)
James Sallans, TCEQ (james.sallans@tceq.texas.gov)
Kristen Schlemmer, BCWK (kristen@bayoucitywaterkeeper.org)

PO Box 1562 | Houston, Texas 77251-1562 | HoustonPublicWorks.org

Capital Projects | Customer Account Services | Houston Permitting Center | Houston Water | Transportation & Drainage Operations



City of Houston - Houston Public Works
Monthly SSO Report
June 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
63822	WQ0010495078	12520 GREENSPPOINT DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system temporary blockage	6/1/2025	8:47	6/1/2025	8:48	0	Cleared Main Line; Cleaned and Disinfected
63826	WQ0010495090	4400 SHERWOOD LN	Bayou/surface water/drainage ditch	Yes	471	City Cleanout	Grease Blockage	6/1/2025	13:23	6/1/2025	16:00	3	Cleared Main Line; Cleaned and Disinfected
63827	WQ0010495090	920 KIRBY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	238	Manhole	Grease Blockage	6/2/2025	8:02	6/2/2025	10:01	2	Cleaned and Disinfected; Cleared Main Line
63829	WQ0010495030	1500 WITTE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	600	Manhole	Grease Blockage	6/2/2025	11:00	6/2/2025	13:00	5	Cleared Main Line; Cleaned and Disinfected
63833	WQ0010495090	2411 FULTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	6/2/2025	11:30	6/2/2025	11:31	0	Cleared City Clean Out; Cleaned and Disinfected
63835	WQ0010495023	6619 NIELAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	6/2/2025	13:30	6/2/2025	13:31	0	Cleaned and Disinfected; Cleared City Clean Out
63837	WQ0010495010	9509 CLINTON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/2/2025	14:45	6/2/2025	14:46	0	Cleared Main Line; Cleaned and Disinfected
63839	WQ0010495002	3448 COYLE ST	Bayou/surface water/drainage ditch	Yes	1745	Manhole	Grease Blockage	6/3/2025	9:15	6/3/2025	15:04	5	Cleaned and Disinfected; Cleared Main Line
63841	WQ0010495037	9955 MAIN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Sample Well	Collection system structural blockage	6/3/2025	10:44	6/3/2025	10:45	0	Cleared City Clean Out; Cleaned and Disinfected
63842	WQ0010495090	5114 LAURA KOPPE RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/3/2025	9:50	6/3/2025	9:51	0	Cleaned and Disinfected; Cleared City Clean Out
63846	WQ0010495010	206 CALLOWAY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/3/2025	13:07	6/3/2025	13:08	0	Cleaned and Disinfected; Cleared Main Line
63851	WQ0010495002	3528 OLD SPANISH TRL	Storm Sewer (not contained)	Yes	0	Private Cleanout	Collection system structural blockage	6/4/2025	14:30	6/4/2025	14:31	0	Set Bypass Pump; Cleaned and Disinfected; Cleared Service Lateral
63854	WQ0010495090	4400 SHERWOOD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	6/4/2025	14:42	6/4/2025	14:43	0	Cleaned and Disinfected
63856	WQ0010495002	4704 PEASE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/4/2025	17:57	6/4/2025	17:58	0	Cleaned and Disinfected; Cleared Main Line
63857	WQ0010495037	5821 CLAREWOOD DR	Storm Sewer (not contained)	Yes	121	Manhole	Rags/Wipes	6/5/2025	7:54	6/5/2025	11:33	1	Cleared Main Line; Cleaned and Disinfected
63858	WQ0010495037	12002 KITTY BROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	936	Manhole	Collection system structural failure	6/5/2025	9:32	6/6/2025	12:21	1	Cleared Main Line; Cleaned and Disinfected
63859	WQ0010495050	1219 ELTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	6/5/2025	10:30	6/5/2025	10:31	0	Cleaned and Disinfected
63860	WQ0010495090	1001 WAUGH DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	194	Manhole	Rags/Wipes	6/5/2025	11:49	6/5/2025	15:03	1	Cleared Main Line; Cleaned and Disinfected
63862	WQ0010495148	10545 TIDWELL RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Force Main	Collection system structural failure	6/5/2025	12:45	6/5/2025	12:46	0	Returned Spill to Sanitary System; Cleaned and Disinfected; Contain All or Portion of Spill



City of Houston - Houston Public Works
Monthly SSO Report
June 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
63864	WQ0010495002	3130 ALABAMA ST	Storm Sewer (not contained)	Yes	0	Service Lateral	Collection system structural blockage	6/5/2025	16:11	6/5/2025	16:12	0	Cleaned and Disinfected
63865	WQ0010495078	1517 GREENS RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system temporary blockage	6/6/2025	8:35	6/6/2025	8:36	0	Cleaned and Disinfected; Returned Spill to Sanitary System
63869	WQ0010495090	1201 SPRING ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system temporary blockage	6/6/2025	9:15	6/6/2025	9:16	0	Cleaned and Disinfected
63876	WQ0010495002	2820 DALTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	6/6/2025	13:42	6/6/2025	13:43	0	Cleaned and Disinfected
63877	WQ0010495076	13726 NORTHWEST FWY	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Grease Blockage	6/6/2025	14:39	6/6/2025	14:40	0	Cleared Main Line; Cleaned and Disinfected
63880	WQ0010495090	4806 ELLA BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/6/2025	16:31	6/6/2025	16:32	0	Set Bypass Pump; Cleaned and Disinfected
63884	WQ0010495111	11623 SHARPVIEW DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	83	City Cleanout	Rags/Wipes	6/8/2025	9:01	6/8/2025	14:36	0	Cleared City Clean Out; Cleaned and Disinfected
63886	WQ0010495090	2409 ABERNATHY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/8/2025	10:10	6/8/2025	10:11	0	Cleared Main Line; Cleaned and Disinfected
63889	WQ0010495090	8007 CAPITOL ST	Bayou/surface water/drainage ditch	Yes	1020	Manhole	Grease Blockage	6/8/2025	11:55	6/8/2025	15:19	5	Cleared Main Line; Cleaned and Disinfected
63892	WQ0010495090	1911 BAGBY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/9/2025	12:43	6/9/2025	12:44	0	Cleaned and Disinfected
63894	WQ0010495002	1400 FOREST OAKS DR	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	City Cleanout	Rags/Wipes	6/9/2025	9:22	6/9/2025	9:23	0	Cleaned and Disinfected; Cleared Main Line; Cleared City Clean Out
63897	WQ0010495090	304 BAYOU ST	Storm Sewer (not contained)	Yes	310	Service Lateral	Collection system structural failure	6/9/2025	11:01	6/9/2025	13:36	2	Cleaned and Disinfected; Set Bypass Pump
63898	WQ0010495146	3103 BIRCH CREEK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	6/9/2025	12:22	6/9/2025	12:23	0	Set Bypass Pump
63901	WQ0010495030	9823 EMNORA LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/9/2025	15:27	6/9/2025	15:28	0	Cleaned and Disinfected
63902	WQ0010495090	3405 MANITOU DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/9/2025	14:00	6/9/2025	14:01	0	Set Bypass Pump; Cleaned and Disinfected; Cleared Main Line
63903	WQ0010495016	8013 SNOWDEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/9/2025	16:11	6/9/2025	16:12	0	Set Bypass Pump
63906	WQ0010495003	12319 ALMEDA RD	Storm Sewer (not contained)	Yes	11000	Force Main	Collection system structural failure	6/9/2025	15:59	6/9/2025	20:00	46	Contain All or Portion of Spill; Cleaned and Disinfected; Returned Spill to Sanitary System
63911	WQ0010495090	5535 CRANE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/10/2025	9:30	6/10/2025	9:31	0	Cleaned and Disinfected
63914	WQ0010495076	9910 TANGIERS RD	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	6/10/2025	11:07	6/10/2025	11:08	0	Cleared City Clean Out; Cleaned and Disinfected
63917	WQ0010495037	36 HACKBERRY LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/10/2025	12:16	6/10/2025	12:17	0	Cleared City Clean Out; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
June 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
63923	WQ0010495003	12734 CHISWICK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	291.5	City Cleanout	Rags/Wipes	6/10/2025	16:01	6/11/2025	11:27	0	Cleaned and Disinfected; Cleared City Clean Out
63927	WQ0010495016	10102 HOMESTEAD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system – wet weather	6/11/2025	13:48	6/11/2025	13:49	0	Cleaned and Disinfected
63929	WQ0010495090	3426 PARKER RD	Storm Sewer (not contained)	Yes	1890	Manhole	Collection system – wet weather	6/12/2025	10:10	6/12/2025	15:26	6	Cleaned and Disinfected
63930	WQ0010495090	10330 EASTEX FWY	Storm Sewer (not contained)	Yes	18360	Manhole	Collection system – wet weather	6/12/2025	10:20	6/12/2025	15:27	60	Cleaned and Disinfected
63931	WQ0010495023	7045 PEYTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/12/2025	9:46	6/12/2025	9:47	0	Cleared Main Line; Cleaned and Disinfected
63932	WQ0010495090	1301 WAYSIDE DR	Storm Sewer (not contained)	Yes	1374	Manhole	Collection system – wet weather	6/12/2025	11:27	6/12/2025	15:10	6	Cleaned and Disinfected
63933	WQ0010495090	6820 LYONS AVE	Storm Sewer (not contained)	Yes	1891	Manhole	Collection system – wet weather	6/12/2025	11:56	6/12/2025	18:41	5	Cleaned and Disinfected
63934	WQ0010495002	4701 PEASE ST	Storm Sewer (not contained)	Yes	1820	Manhole	Collection system – wet weather	6/12/2025	12:32	6/12/2025	14:03	20	Cleaned and Disinfected
63936	WQ0010495112	24119 GLENGYLE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system – wet weather	6/12/2025	10:47	6/12/2025	10:48	0	Cleaned and Disinfected
63937	WQ0010495050	638 SULPHUR ST	Storm Sewer (not contained)	Yes	170	Manhole	Collection system – wet weather	6/12/2025	12:10	6/12/2025	13:35	2	Cleaned and Disinfected
63940	WQ0010495090	1602 NOBLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	236	City Cleanout	Grease Blockage	6/12/2025	17:26	6/12/2025	19:24	2	Cleared City Clean Out; Cleaned and Disinfected
63942	WQ0010495037	3802 TARTAN LN	Storm Sewer (not contained)	Yes	10945	Manhole	Collection system structural blockage	6/12/2025	17:57	6/13/2025	12:37	10	Cleaned and Disinfected; Cleared Main Line
63945	WQ0010495090	5517 CAPLIN ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	2814	Manhole	Grease Blockage	6/13/2025	11:53	6/15/2025	10:47	1	Cleaned and Disinfected; Cleared Main Line
63946	WQ0010495090	12 HYDE PARK BLVD	Storm Sewer (not contained)	Yes	1350	Manhole	Grease Blockage	6/13/2025	12:15	6/13/2025	12:45	45	Cleared Main Line; Cleaned and Disinfected
63947	WQ0010495003	2736 VIRGINIA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	6/13/2025	15:10	6/13/2025	15:11	0	Cleared Main Line; Cleaned and Disinfected
63951	WQ0010495002	5734 BURWELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	6/14/2025	9:08	6/14/2025	9:09	0	Cleaned and Disinfected; Cleared Main Line
63952	WQ0010495119	11500 POST OAK RD	Storm Sewer (not contained)	Yes	21	Manhole	Collection system structural blockage	6/14/2025	9:01	6/14/2025	10:25	0	Cleaned and Disinfected; Cleared Main Line
63955	WQ0010495003	1701 COMMONWEALTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	6/15/2025	8:28	6/15/2025	8:29	0	Cleaned and Disinfected; Cleared City Clean Out
63960	WQ0010495002	2533 SOUTHMORE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/15/2025	9:07	6/15/2025	9:08	0	Cleared Main Line; Cleaned and Disinfected
63962	WQ0010495030	11901 BARRYKNOLL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/15/2025	12:48	6/15/2025	12:49	0	Cleaned and Disinfected; Set Bypass Pump

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
Monthly SSO Report
June 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
63963	WQ0010495146	4027 QUIET GLADE CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	6/16/2025	9:14	6/16/2025	9:15	0	Cleaned and Disinfected; Cleared Main Line
63966	WQ0010495090	1947 OJEMAN RD	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Collection system structural failure	6/16/2025	10:11	6/16/2025	10:12	0	Set Bypass Pump; Cleaned and Disinfected
63970	WQ0010495002	6702 ILEX ST	Storm Sewer (not contained)	Yes	4410	Manhole	Collection system structural failure	6/16/2025	11:11	6/17/2025	10:07	3	Set Bypass Pump; Cleared Main Line; Cleaned and Disinfected
63971	WQ0010495112	315 COVECREST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Pump/Lift Station Electrical Failure	6/15/2025	23:30	6/15/2025	23:31	0	Cleaned and Disinfected
63972	WQ0010495090	2119 GOSTICK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/16/2025	13:20	6/16/2025	13:21	0	Cleared City Clean Out; Cleaned and Disinfected
63973	WQ0010495090	305 66TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/16/2025	14:07	6/16/2025	14:08	0	Cleared City Clean Out; Cleaned and Disinfected
63975	WQ0010495016	10518 WOODWICK ST	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	6/16/2025	14:00	6/16/2025	14:01	0	Cleared Main Line; Cleaned and Disinfected
63979	WQ0010495090	413 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1435	Private Cleanout	Grease Blockage	6/16/2025	17:41	6/17/2025	11:00	1	Cleaned and Disinfected; Cleared Main Line
63981	WQ0010495090	808 FRAWLEY ST	Storm Sewer (not contained)	Yes	129.5	Manhole	Grease Blockage	6/17/2025	8:30	6/17/2025	12:49	0	Cleared Main Line; Cleaned and Disinfected
63983	WQ0010495009	4917 HOLLOWAY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	194	Manhole	Grease Blockage	6/17/2025	10:45	6/17/2025	13:59	1	Cleaned and Disinfected; Cleared Main Line
63987	WQ0010495090	116 KENDALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	6/17/2025	13:30	6/17/2025	13:31	0	Cleared Main Line; Cleaned and Disinfected
63997	WQ0010495076	4303 BIRCHCROFT DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	250	Manhole	Grease Blockage	6/19/2025	11:50	6/19/2025	16:00	1	Cleared Main Line; Cleaned and Disinfected
63998	WQ0010495090	9818 HARDY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Roots	6/20/2025	8:42	6/20/2025	8:43	0	Cleaned and Disinfected
63999	WQ0010495002	5603 ORIOLE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	316	Manhole	Grease Blockage	6/20/2025	8:52	6/20/2025	11:30	2	Cleared Main Line; Cleaned and Disinfected
64001	WQ0010495090	8713 WHEATLEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/20/2025	9:48	6/20/2025	9:49	0	Cleared Main Line; Cleaned and Disinfected
64003	WQ0010495110	5444 RIDGEMONT PL	Storm Sewer (not contained)	Yes	4059	Manhole	Grease Blockage	6/20/2025	13:57	6/21/2025	12:30	3	Cleaned and Disinfected; Cleared Main Line
64008	WQ0010495037	5959 RICHMOND AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/21/2025	8:43	6/21/2025	8:44	0	Cleaned and Disinfected; Set Bypass Pump
64010	WQ0010495003	1701 COMMONWEALTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/21/2025	10:29	6/21/2025	10:30	0	Cleared City Clean Out; Cleaned and Disinfected
64011	WQ0010495016	7438 YOE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/21/2025	14:20	6/21/2025	14:21	0	Cleared City Clean Out; Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.



City of Houston - Houston Public Works
Monthly SSO Report
June 2025


SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
64012	WQ0010495090	605 BERRY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/21/2025	15:57	6/21/2025	15:58	0	Cleared Main Line; Cleaned and Disinfected
64015	WQ0010495002	8626 BRANDON ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Grease Blockage	6/22/2025	8:55	6/22/2025	8:56	0	Cleared Main Line; Cleaned and Disinfected
64023	WQ0010495090	8630 BERTWOOD ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	City Cleanout	Grease Blockage	6/23/2025	10:00	6/23/2025	10:01	0	Cleared City Clean Out; Cleaned and Disinfected
64026	WQ0010495090	7936 AVENUE E	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/23/2025	10:50	6/23/2025	10:51	0	Cleaned and Disinfected
64027	WQ0010495090	2432 QUENBY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	6/23/2025	12:08	6/23/2025	12:09	0	Cleaned and Disinfected
64028	WQ0010495090	1115 PROVIDENCE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1351	Private Cleanout	Rags/Wipes	6/23/2025	12:26	6/24/2025	10:57	1	Cleared Main Line; Cleaned and Disinfected
64029	WQ0010495090	2014 HADDON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	6/23/2025	13:24	6/23/2025	13:25	0	Cleaned and Disinfected
64032	WQ0010495090	1619 ALTHEA DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/24/2025	10:57	6/24/2025	10:58	0	Cleaned and Disinfected; Set Bypass Pump
64035	WQ0010495003	10800 SCOTT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/23/2025	16:40	6/23/2025	16:41	0	Cleaned and Disinfected
64036	WQ0010495023	7808 QUEEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Rags/Wipes	6/23/2025	17:31	6/23/2025	17:32	0	Cleaned and Disinfected; Cleared City Clean Out
64038	WQ0010495050	8114 TARBELL RD	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	6/24/2025	9:06	6/24/2025	9:07	0	Cleaned and Disinfected; Cleared City Clean Out
64040	WQ0010495116	3504 DAIRY ASHFORD RD	Storm Sewer (not contained)	Yes	0	Private Cleanout	Grease Blockage	6/24/2025	9:37	6/24/2025	9:38	0	Cleaned and Disinfected; Cleared Main Line
64047	WQ0010495090	5517 CAPLIN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	38	Manhole	Collection system temporary blockage	6/24/2025	10:12	6/24/2025	10:50	1	Cleaned and Disinfected; Set Bypass Pump
64052	WQ0010495002	8517 BAKER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	159	Manhole	Rags/Wipes	6/25/2025	10:06	6/25/2025	12:45	1	Cleared Main Line; Cleaned and Disinfected
64055	WQ0010495090	2702 CRESTON DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	6/25/2025	12:01	6/25/2025	12:02	0	Cleaned and Disinfected; Cleared Main Line
64056	WQ0010495133	1303 GREENS PKWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	356	Manhole	Collection system temporary blockage	6/23/2025	11:34	6/23/2025	17:30	1	Cleared Main Line; Cleaned and Disinfected
64058	WQ0010495090	130 CHRISTENSEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	6/25/2025	12:55	6/25/2025	12:56	0	Cleaned and Disinfected
64068	WQ0010495003	2424 DUNSTAN RD	Storm Sewer (not contained)	Yes	1015	Private Cleanout	Collection system structural failure	6/25/2025	18:06	6/25/2025	20:31	7	Set Bypass Pump; Cleaned and Disinfected
64069	WQ0010495002	3510 MOUNT PLEASANT ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	6/26/2025	7:46	6/26/2025	7:47	0	Cleared City Clean Out; Cleaned and Disinfected
64070	WQ0010495002	2614 DREW ST	Bayou/surface water/drainage ditch	Yes	311	City Cleanout	Rags/Wipes	6/26/2025	9:16	6/26/2025	14:27	1	Cleared City Clean Out; Cleaned and Disinfected
64073	WQ0010495110	5623 IRISH HILL DR	Storm Sewer (not contained)	Yes	322	Manhole	Grease Blockage	6/26/2025	11:48	6/26/2025	14:28	2	Cleaned and Disinfected; Cleared Main Line



City of Houston - Houston Public Works
Monthly SSO Report
June 2025

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
64075	WQ0010495079	9904 KINGSPPOINT RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1940	Force Main	Collection system structural failure	6/26/2025	8:00	6/26/2025	12:00	8	Contain All or Portion of Spill; Returned Spill to Sanitary System
64083	WQ0010495090	1410 POST OAK PARK DR	Storm Sewer (not contained)	Yes	1050	Manhole	Collection system structural failure	6/27/2025	9:00	6/27/2025	12:30	5	Set Bypass Pump; Cleaned and Disinfected
64089	WQ0010495090	5517 CAPLIN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/27/2025	11:21	6/27/2025	11:22	0	Set Bypass Pump; Cleaned and Disinfected
64090	WQ0010495090	10000 MEMORIAL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	4500	Manhole	Power Outage	6/26/2025	19:30	6/26/2025	20:30	75	Cleaned and Disinfected
64091	WQ0010495003	2424 DUNSTAN RD	Storm Sewer (not contained)	Yes	1043	Private Cleanout	Collection system structural failure	6/27/2025	11:46	6/27/2025	14:15	7	Set Bypass Pump; Cleaned and Disinfected
64092	WQ0010495037	5310 GLENMONT DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/27/2025	11:47	6/27/2025	11:48	0	Cleaned and Disinfected
64096	WQ0010495090	113 SIDNEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/27/2025	12:55	6/27/2025	12:56	0	Cleaned and Disinfected; Set Bypass Pump
64103	WQ0010495149	2119 LAUREL SPRINGS LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	6/29/2025	9:30	6/29/2025	9:31	0	Cleaned and Disinfected
64107	WQ0010495090	3816 SEARLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/30/2025	9:52	6/30/2025	9:53	0	Cleared City Clean Out; Cleaned and Disinfected
64108	WQ0010495090	8007 CAPITOL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	213	Manhole	Grease Blockage	6/30/2025	9:45	6/30/2025	13:18	1	Cleared Main Line; Cleaned and Disinfected
64110	WQ0010495090	6817 AVENUE U	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	3160	Force Main	Air Relief Valve (ARV) Failure	6/30/2025	11:00	7/1/2025	13:20	2	Cleaned and Disinfected
64118	WQ0010495090	3916 AVERILL ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Grease Blockage	6/30/2025	13:40	6/30/2025	13:41	0	Cleared Main Line; Cleaned and Disinfected

Total Number of SSOs:	111
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

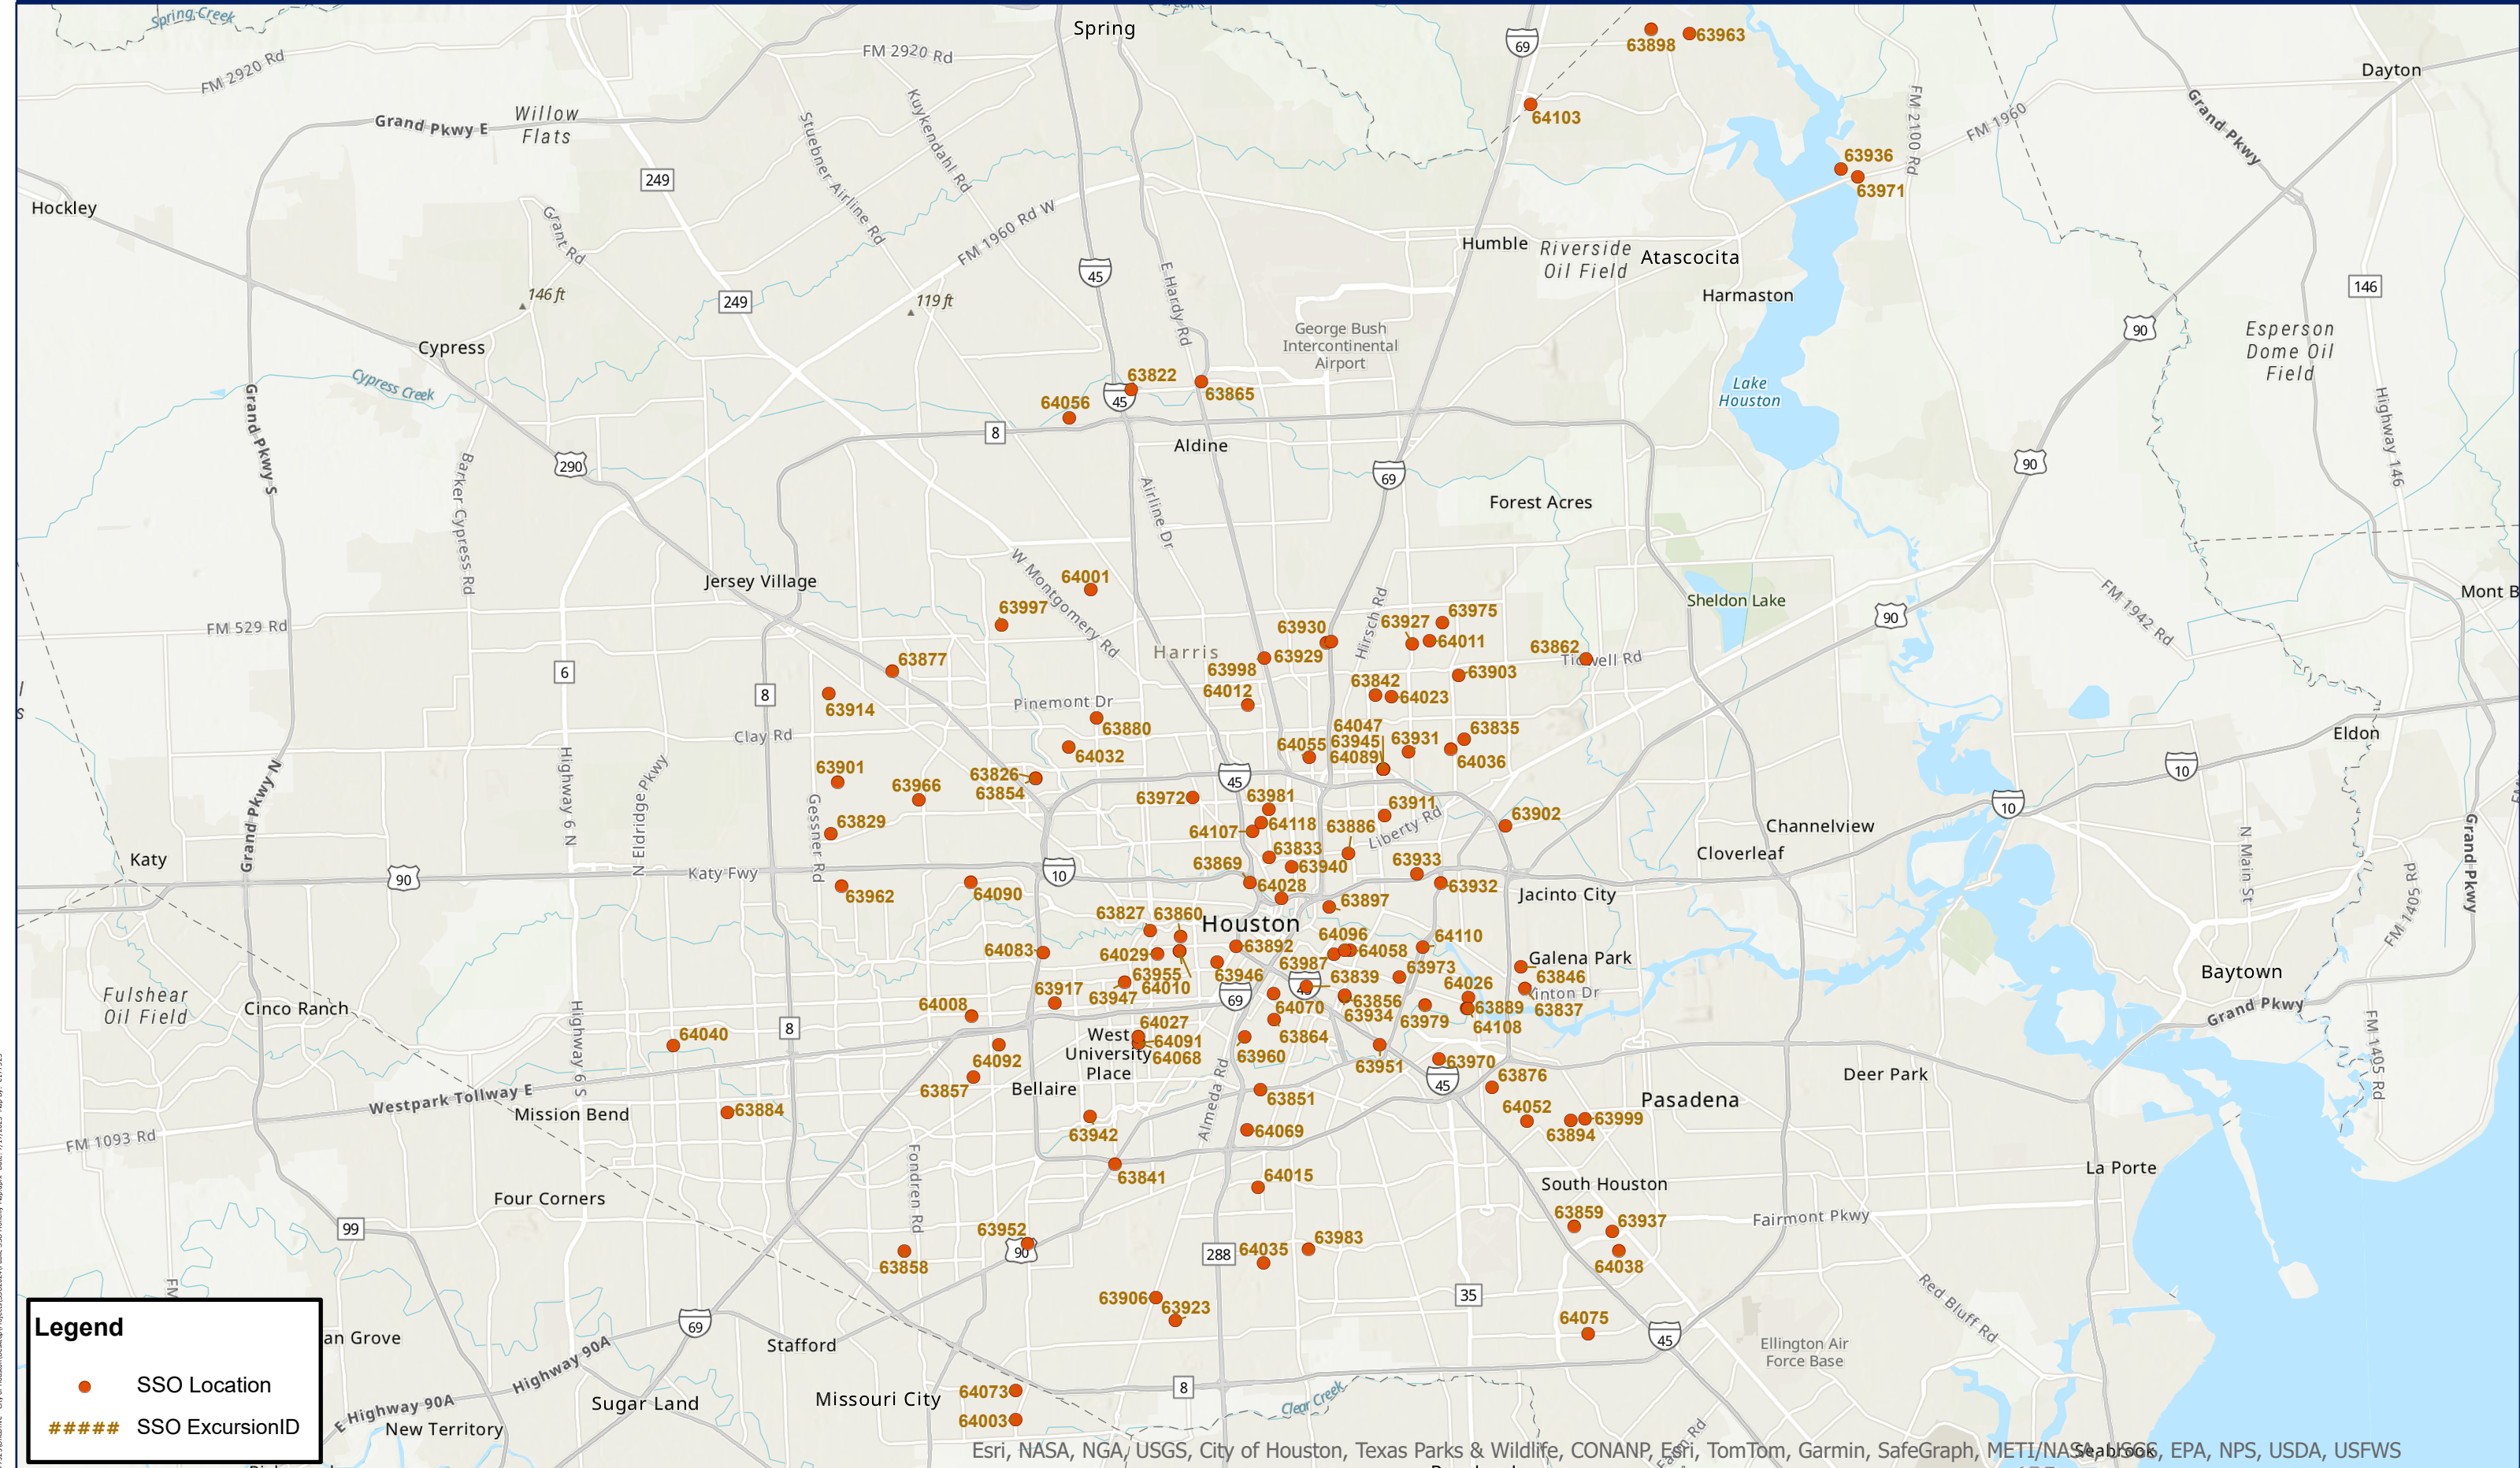

Document Path: C:\Users\j7752\OneDrive - City of Houston\Desktop\Projects\SSO\SSO Public SSO Monthly Map.aprx Date: 7/17/2025 Map By: e177523

Legend

●

SSO Location

#####

SSO ExcursionID