



July 19, 2022

Associate Director, Water Enforcement
U.S. Environmental Protection Agency
Region VI
1201 Elm Street, Suite 500
Mail Code ECADW
Dallas, Texas 75270-2102

Via USPS Certified Mail
7018 3090 0000 0192 9791
Via E-mail: Smalley.bryant@epa.gov

Re: City of Houston Wastewater Consent Decree
Civil Action No. 4:18-cv-03368
Monthly SSO Report – June 2022

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for June 2022 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Sincerely,

Phillip Goodwin
Regulatory Compliance Director
Houston Public Works, City of Houston

Enc. June 2022 Monthly SSO Report; SSO Map for June 2022

cc via email: Nathaniel Douglas, DOJ (Nathaniel.douglas@usdoj.gov)
James Zimny, EPA (Zimny.james@epa.gov)
Alan Vaughn, EPA (vaughn.alan@epa.gov)
Phillip Ledbetter, Texas AG's Office (phillip.ledbetter@oag.texas.gov);
James Sallans, TCEQ (james.sallans@tceq.texas.gov)
Kristen Schlemmer, BCWK (kristen@bayoucitywaterkeeper.org)

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
47654	WQ0010495030	9615 KEMPWOOD DR	Storm Sewer (not contained)	Yes	53	Manhole	Grease Blockage	6/1/2022	9:14	6/1/2022	11:00	1	Cleared Main Line;Cleaned and Disinfected
47656	WQ0010495090	1803 LUBBOCK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	215	City Cleanout	Rags/Wipes	6/1/2022	10:15	6/1/2022	13:50	1	Cleaned and Disinfected;Cleared City Clean Out
47658	WQ0010495077	803 CENTERWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	606	Manhole	Grease Blockage	6/1/2022	9:52	6/1/2022	14:55	2	Cleaned and Disinfected;Cleared Main Line
47659	WQ0010495090	2001 KARBACH ST	Storm Sewer (not contained)	Yes	691.5	City Cleanout	Grease Blockage	6/1/2022	13:37	6/2/2022	12:40	1	Cleaned and Disinfected;Cleared Service Lateral
47666	WQ0010495111	7511 TIMBERWAY LN	Storm Sewer (not contained)	Yes	2138	Manhole	Grease Blockage	6/1/2022	17:58	6/2/2022	11:47	2	Cleared Main Line;Cleaned and Disinfected
47667	WQ0010495111	10715 MEADOWGLEN LN	Storm Sewer (not contained)	Yes	759	Manhole	Grease Blockage	6/2/2022	8:12	6/2/2022	12:25	3	Cleared Main Line;Cleaned and Disinfected
47668	WQ0010495010	221 BOLDEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1784	Private Cleanout	Grease Blockage	6/2/2022	9:31	6/3/2022	15:15	1	Cleared Main Line;Cleaned and Disinfected
47672	WQ0010495003	1846 COLQUITT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	6/2/2022	12:17	6/2/2022	12:17	0	Cleared Service Lateral;Cleaned and Disinfected
47678	WQ0010495111	10615 MEADOWGLEN LN	Storm Sewer (not contained)	Yes	759	Manhole	Grease Blockage	6/2/2022	8:12	6/2/2022	12:25	3	Cleared Main Line;Cleaned and Disinfected
47679	WQ0010495111	10615 MEADOWGLEN LN	Storm Sewer (not contained)	Yes	759	Manhole	Grease Blockage	6/2/2022	8:12	6/2/2022	12:25	3	Cleared Main Line;Cleaned and Disinfected
47682	WQ0010495016	7915 CAROLWOOD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural blockage	6/3/2022	11:27	6/3/2022	11:27	0	Cleaned and Disinfected
47687	WQ0010495003	1107 WILLARD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	6/5/2022	8:42	6/5/2022	8:42	0	Cleaned and Disinfected;Set Bypass Pump
47690	WQ0010495116	3407 PARKRIDGE GLEN DR	Storm Sewer (not contained)	Yes	162	Manhole	Grease Blockage	6/5/2022	12:39	6/5/2022	14:00	2	Cleared Main Line;Cleaned and Disinfected
47692	WQ0010495090	6805 ROSWELL ST	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	6/6/2022	9:23	6/6/2022	9:23	0	Cleared Main Line;Cleaned and Disinfected
47696	WQ0010495037	7715 FAWN TERRACE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1406	Manhole	Grease Blockage	6/6/2022	12:34	6/7/2022	12:00	1	Cleared Main Line;Cleaned and Disinfected

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.


SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
47702	WQ0010495090	114 ROBMORE ST	Bayou/surface water/drainage ditch	Yes	0	Service Lateral	Grease Blockage	6/6/2022	16:46	6/6/2022	16:46	0	Cleared Main Line;Cleaned and Disinfected
47703	WQ0010495077	12723 EASTBROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Force Main	Air Relief Valve (ARV) Failure	6/6/2022	18:00	6/6/2022	18:00	0	Cleaned and Disinfected
47712	WQ0010495090	1039 YALE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	196	Private Cleanout	Grease Blockage	6/8/2022	8:14	6/8/2022	11:30	1	Cleaned and Disinfected;Cleared Main Line
47714	WQ0010495116	3505 S DAIRY ASHFORD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	384	Manhole	Collection system structural blockage	6/8/2022	9:28	6/8/2022	15:52	1	Cleaned and Disinfected;Set Bypass Pump
47715	WQ0010495090	2201 CONGRESS ST	Storm Sewer (not contained)	Yes	1461	Manhole	Collection system structural blockage	6/8/2022	11:09	6/9/2022	11:30	1	Cleaned and Disinfected;Set Bypass Pump
47721	WQ0010495002	8122 GLEN VALLEY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	6/9/2022	10:30	6/9/2022	23:28	0	Cleaned and Disinfected
47728	WQ0010495030	9615 KEMPWOOD DR	Storm Sewer (not contained)	Yes	300	Manhole	Grease Blockage	6/10/2022	11:40	6/10/2022	14:10	2	Cleaned and Disinfected;Cleared Main Line
47732	WQ0010495116	8102 WESTHEIMER RD	Storm Sewer (not contained)	Yes	16.75	Service Lateral	Rags/Wipes	6/10/2022	15:06	6/10/2022	16:13	0	Cleared Service Lateral;Cleaned and Disinfected
47733	WQ0010495002	7125 SIDNEY ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	6/10/2022	15:30	6/10/2022	15:30	0	Cleared Service Lateral;Cleaned and Disinfected
47735	WQ0010495002	5839 SOUTHMONT ST	Contained On Site	No	0	Private Cleanout	Rags/Wipes	6/10/2022	16:35	6/11/2022	17:48	0	Cleaned and Disinfected;Cleared Service Lateral
47736	WQ0010495119	8181 COLONY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	324	Manhole	Grease Blockage	6/11/2022	9:48	6/11/2022	12:30	2	Cleaned and Disinfected;Cleared Main Line
47738	WQ0010495002	6825 S LOOP FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	6/11/2022	11:55	6/11/2022	11:55	0	Cleaned and Disinfected;Cleared Main Line
47745	WQ0010495076	7844 GREEN LAWN DR	Storm Sewer (not contained)	Yes	1681.5	Manhole	Grease Blockage	6/12/2022	16:36	6/13/2022	11:17	2	Cleared Main Line;Cleaned and Disinfected
47754	WQ0010495002	4706 YELLOWSTONE BLVD	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	6/13/2022	15:15	6/13/2022	15:15	0	Cleared Service Lateral;Cleaned and Disinfected
47759	WQ0010495003	14003 DUBLIN ST	Storm Sewer (not contained)	Yes	208	Manhole	Grease Blockage	6/14/2022	12:31	6/14/2022	14:15	2	Cleaned and Disinfected;Cleared Main Line

Additional Comments: Please note that where estimated volume and average flow are reported as "0", evidence of an SSO was observed but no active overflow was occurring. Consequently, flow rate and total volume loss could not be calculated.

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
47769	WQ0010495037	5909 FONDREN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1466	Manhole	Grease Blockage	6/15/2022	11:29	6/16/2022	11:55	1	Set Bypass Pump;Cleaned and Disinfected
47778	WQ0010495111	11202 MEADOWGLEN LN	Storm Sewer (not contained)	Yes	930	Manhole	Grease Blockage	6/17/2022	11:57	6/17/2022	13:30	10	Cleaned and Disinfected;Cleared Main Line
47779	WQ0010495090	738 HOFFMAN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/17/2022	14:22	6/17/2022	14:22	0	Cleared Main Line;Cleaned and Disinfected
47786	WQ0010495003	600 E ANDERSON RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1109	City Cleanout	Grease Blockage	6/19/2022	16:16	6/20/2022	10:45	1	Cleaned and Disinfected;Cleared City Clean Out
47790	WQ0010495003	13302 INNSHIRE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Collection system structural blockage	6/20/2022	10:21	6/20/2022	10:21	0	Cleaned and Disinfected;Cleared Service Lateral;Set Bypass Pump
47791	WQ0010495110	16403 LOST QUAIL DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	151	Manhole	Grease Blockage	6/20/2022	11:09	6/20/2022	13:40	1	Cleaned and Disinfected;Cleared Main Line
47795	WQ0010495003	1109 HYDE PARK BLVD	Storm Sewer (not contained)	Yes	121	City Cleanout	Rags/Wipes	6/20/2022	14:09	6/20/2022	16:40	1	Cleared City Clean Out;Cleaned and Disinfected
47796	WQ0010495090	106 SADDLEBROOK LN	Storm Sewer (not contained)	Yes	104	Manhole	Grease Blockage	6/20/2022	15:36	6/20/2022	17:20	1	Cleaned and Disinfected;Cleared Main Line
47799	WQ0010495119	11303 BARRETT BRAE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/21/2022	8:54	6/21/2022	8:54	0	Cleared Service Lateral;Cleaned and Disinfected
47804	WQ0010495090	5017 DENMARK ST	Bayou/surface water/drainage ditch	Yes	351.6	City Cleanout	Grease Blockage	6/21/2022	17:28	6/22/2022	13:00	0	Cleaned and Disinfected;Cleared Service Lateral
47808	WQ0010495076	5700 THOUSAND OAKS CIR	Storm Sewer (not contained)	Yes	158	City Cleanout	Grease Blockage	6/22/2022	12:52	6/22/2022	15:30	1	Cleared Main Line;Cleaned and Disinfected
47810	WQ0010495090	907 GREGG ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	6/22/2022	17:08	6/22/2022	17:08	0	Cleared City Clean Out;Cleaned and Disinfected
47814	WQ0010495076	5700 THOUSAND OAKS CIR	Storm Sewer (not contained)	Yes	248	City Cleanout	Grease Blockage	6/23/2022	9:44	6/23/2022	11:48	2	Cleared Main Line;Cleaned and Disinfected
47817	WQ0010495003	3800 AUDLEY ST	Storm Sewer (not contained)	Yes	690	Manhole	Grease Blockage	6/23/2022	11:29	6/23/2022	17:14	2	Cleaned and Disinfected;Cleared Main Line

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
47819	WQ0010495122	15004 CROSSWINDS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	975	Manhole	Collection system temporary blockage	6/23/2022	13:30	6/23/2022	14:45	13	Cleaned and Disinfected;Contain All or Portion of Spill
47829	WQ0010495090	1434 SILVERDALE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/24/2022	17:50	6/24/2022	17:51	0	Cleaned and Disinfected;Cleared Main Line
48832	WQ0010495002	1554 ELLIOTT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	6/25/2022	13:48	6/25/2022	13:49	0	Cleaned and Disinfected;Cleared Main Line
48833	WQ0010495090	5514 HIRSCH RD	Storm Sewer (not contained)	Yes	81	Manhole	Grease Blockage	6/25/2022	15:54	6/25/2022	17:15	1	Cleaned and Disinfected;Cleared Main Line
48835	WQ0010495090	1444 ALEXANDER ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Grease Blockage	6/26/2022	14:08	6/26/2022	14:09	0	Cleared Main Line;Cleaned and Disinfected
48843	WQ0010495030	10402 TOWN AND COUNTRY WAY	Storm Sewer (not contained)	Yes	4086	Manhole	Grease Blockage	6/27/2022	13:18	6/28/2022	12:00	3	Cleared Main Line;Cleaned and Disinfected
48852	WQ0010495037	9717 BEVLVN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	465	Manhole	Grease Blockage	6/28/2022	8:17	6/28/2022	16:01	1	Cleared Main Line;Cleaned and Disinfected
48855	WQ0010495142	50 SORTERS MCCLELLAN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	2580	Manhole	Collection system structural blockage	6/28/2022	15:23	6/28/2022	16:49	30	Cleared Main Line;Cleaned and Disinfected;Contain All or Portion of Spill
48861	WQ0010495090	230 VICTORIA DR	Bayou/surface water/drainage ditch	Yes	0	Manhole	Grease Blockage	6/29/2022	13:20	6/29/2022	13:21	0	Cleared Main Line;Cleaned and Disinfected
48866	WQ0010495090	4400 N SHEPHERD DR	Storm Sewer (not contained)	Yes	267	Manhole	Rags/Wipes	6/30/2022	9:07	6/30/2022	13:34	1	Cleared Service Lateral
48868	WQ0010495119	12210 W BELLFORT ST	Storm Sewer (not contained)	Yes	1032	Force Main	Air Relief Valve (ARV) Failure	6/30/2022	9:46	6/30/2022	15:30	3	Cleaned and Disinfected

Total Number of SSOs:	55
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

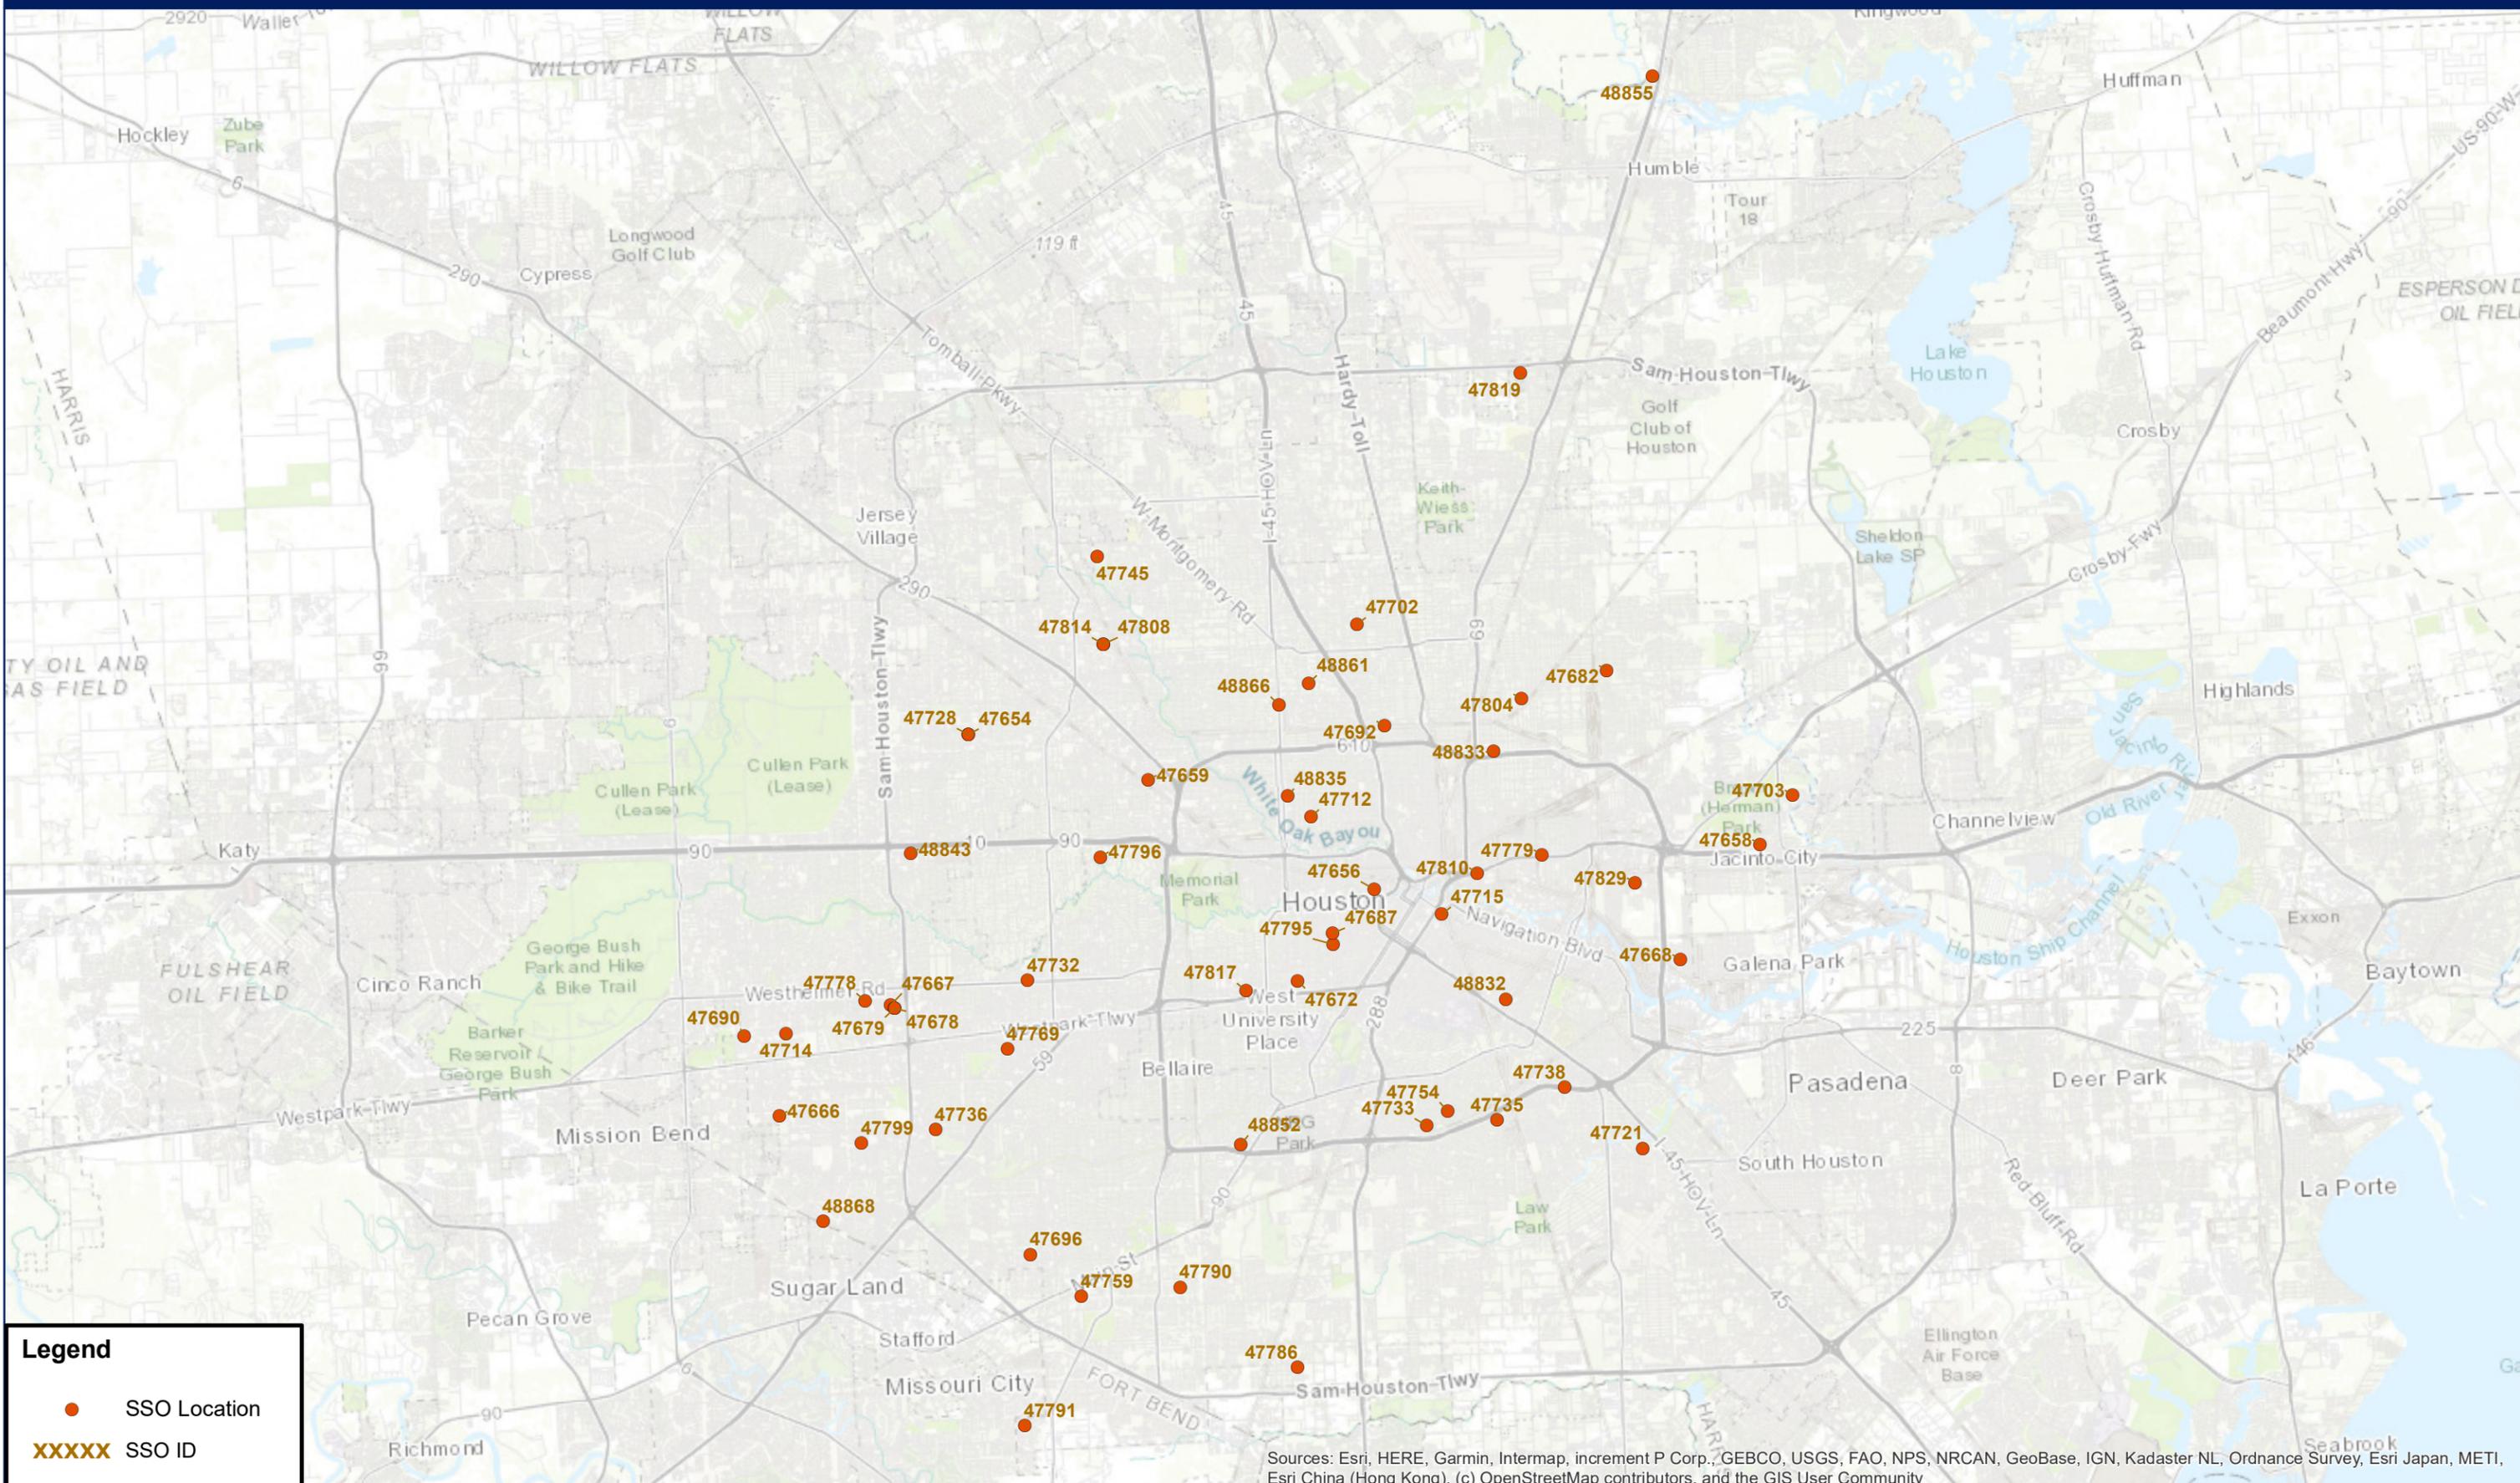

Legend

- SSO Location
- XXXXX SSO ID

Sources: Esri, HERE, Garmin, Intermap, increment P Corp., GEBCO, USGS, FAO, NPS, NRCAN, GeoBase, IGN, Kadaster NL, Ordnance Survey, Esri Japan, METI, Esri China (Hong Kong), (c) OpenStreetMap contributors, and the GIS User Community