



January 17, 2025

Associate Director, Water Enforcement
U.S. Environmental Protection Agency
Region VI
1201 Elm Street, Suite 500
Mail Code ECADW
Dallas, Texas 75270-2102

Via E-mail: Smalley.bryant@epa.gov


Re: City of Houston Wastewater Consent Decree
Civil Action No. 4:18-cv-03368
Monthly SSO Report – December 2024

Dear Mr. Smalley:

The City of Houston's monthly SSO summary report for December 2024 and corresponding SSO map are attached and provided in compliance with the requirements of Paragraph 61 of the City of Houston Wastewater Consent Decree.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering such information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Sincerely,

DocuSigned by:
Phillip Goodwin

Phillip Goodwin

Senior Assistant Director
Houston Public Works, City of Houston

Enc. December 2024 Monthly SSO Report; SSO Map for December 2024
cc via email: Thomas Carroll, DOJ (Thomas.Carroll@usdoj.gov)
James Zimny, EPA (Zimny.james@epa.gov)
Alan Vaughn, EPA (vaughn.alan@epa.gov)
Brittany Wright, Texas AG's Office (Brittany.Wright@oag.texas.gov)
James Sallans, TCEQ (james.sallans@tceq.texas.gov)
Kristen Schlemmer, BCWK (kristen@bayoucitywaterkeeper.org)

PO Box 1562 | Houston, Texas 77251-1562 | HoustonPublicWorks.org

Capital Projects | Customer Account Services | Houston Permitting Center | Houston Water | Transportation & Drainage Operations

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61053	WQ0010495037	10911 VALLEY HILLS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/1/2024	11:45	12/1/2024	11:46	0	Cleaned and Disinfected
61055	WQ0010495095	7825 WINDWARD PASSAGE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/2/2024	8:24	12/2/2024	8:25	0	Cleaned and Disinfected; Cleared City Clean Out
61062	WQ0010495016	5940 MOHAWK ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	12/2/2024	10:47	12/2/2024	10:48	0	Cleaned and Disinfected; Cleared City Clean Out
61064	WQ0010495090	733 ZOE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/2/2024	11:05	12/2/2024	11:06	0	Cleaned and Disinfected; Cleared Main Line
61066	WQ0010495010	9829 KERR ST	Bayou/surface water/drainage ditch	Yes	2960	City Cleanout	Rags/Wipes	12/2/2024	11:14	12/3/2024	11:54	2	Cleaned and Disinfected; Cleared City Clean Out
61067	WQ0010495079	10002 KIRKGLLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/2/2024	10:40	12/2/2024	10:41	0	Cleaned and Disinfected; Cleared Main Line
61068	WQ0010495037	6768 RENWICK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/2/2024	11:49	12/2/2024	11:50	0	Cleaned and Disinfected; Cleared City Clean Out
61070	WQ0010495090	1206 LAURENTIDE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/2/2024	12:00	12/2/2024	12:01	0	Cleaned and Disinfected
61071	WQ0010495002	7730 GREENDOWNS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/2/2024	12:20	12/2/2024	12:21	0	Cleared Main Line; Cleaned and Disinfected
61072	WQ0010495037	11284 SANDPIPER DR	Storm Sewer (not contained)	Yes	600	Manhole	Grease Blockage	12/2/2024	16:30	12/2/2024	18:30	5	Cleared Main Line; Cleaned and Disinfected
61073	WQ0010495023	7373 WAYSIDE DR	Storm Sewer (not contained)	Yes	2763	Manhole	Grease Blockage	12/2/2024	14:12	12/3/2024	13:26	2	Cleared Main Line; Cleaned and Disinfected
61075	WQ0010495119	10400 BISSONNET ST	Storm Sewer (not contained)	Yes	576	Manhole	Grease Blockage	12/2/2024	15:20	12/2/2024	20:08	2	Cleaned and Disinfected; Cleared Main Line
61076	WQ0010495090	1106 ROXELLA ST	Bayou/surface water/drainage ditch	Yes	1189	City Cleanout	Grease Blockage	12/2/2024	15:37	12/3/2024	11:26	1	Cleared Service Lateral; Cleaned and Disinfected
61085	WQ0010495016	8154 RECORD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/3/2024	8:51	12/3/2024	8:52	0	Cleaned and Disinfected; Cleared Service Lateral
61086	WQ0010495090	1413 COPELAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1848	City Cleanout	Rags/Wipes	12/3/2024	10:38	12/4/2024	17:26	1	Cleaned and Disinfected; Cleared City Clean Out
61087	WQ0010495090	2021 JACQUELYN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/3/2024	10:35	12/3/2024	10:36	0	Cleaned and Disinfected
61089	WQ0010495100	1000 GREENS RD	Storm Sewer (not contained)	Yes	1666	City Cleanout	Grease Blockage	12/3/2024	14:42	12/4/2024	18:28	1	Cleaned and Disinfected; Cleared Main Line
61095	WQ0010495111	13002 WIREVINE LN	Storm Sewer (not contained)	Yes	147	Manhole	Grease Blockage	12/4/2024	8:32	12/4/2024	10:59	1	Cleared Main Line; Cleaned and Disinfected
61096	WQ0010495002	5922 HONEYSUCKLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/4/2024	9:00	12/4/2024	9:01	0	Cleared City Clean Out; Cleaned and Disinfected
61099	WQ0010495016	9102 LAKE FOREST BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/4/2024	10:37	12/4/2024	10:38	0	Cleaned and Disinfected; Cleared Service Lateral
61101	WQ0010495002	7003 PLUM CREEK TRAIL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/4/2024	9:14	12/4/2024	9:15	0	Cleared Main Line; Cleaned and Disinfected
61103	WQ0010495090	1924 CHAPMAN ST	Storm Sewer (not contained)	Yes	0	Service Lateral	Collection system structural failure	12/4/2024	11:16	12/4/2024	11:17	0	Cleared Service Lateral; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61106	WQ0010495002	7614 THUROW ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/4/2024	14:35	12/4/2024	14:36	0	Cleared City Clean Out; Cleaned and Disinfected
61107	WQ0010495009	11303 SANDHURST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/4/2024	15:20	12/4/2024	15:21	0	Set Bypass Pump; Cleaned and Disinfected
61108	WQ0010495003	13899 POST OAK RD	Storm Sewer (not contained)	Yes	1267	Private Sample Well	Grease Blockage	12/4/2024	14:58	12/5/2024	12:05	1	Cleared Main Line; Cleaned and Disinfected
61109	WQ0010495111	6300 CORPORATE DR	Storm Sewer (not contained)	Yes	3390	Manhole	Grease Blockage	12/4/2024	15:35	12/5/2024	10:25	3	Cleared Main Line; Cleaned and Disinfected
61118	WQ0010495090	2239 HUTTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/5/2024	9:56	12/5/2024	9:57	0	Cleaned and Disinfected; Cleared Main Line
61121	WQ0010495090	6917 LYONS AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/5/2024	11:17	12/5/2024	11:18	0	Cleaned and Disinfected
61122	WQ0010495090	323 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/5/2024	11:18	12/5/2024	11:19	0	Cleared Main Line; Cleaned and Disinfected
61126	WQ0010495077	12405 EAST FWY	Storm Sewer (not contained)	Yes	1521	City Cleanout	Grease Blockage	12/5/2024	16:01	12/6/2024	0:28	3	Cleared City Clean Out; Cleaned and Disinfected
61127	WQ0010495077	12813 COULSON ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	12/5/2024	17:20	12/5/2024	17:21	0	Cleared Main Line; Cleaned and Disinfected
61129	WQ0010495090	1500 MCKINNEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural blockage	12/5/2024	17:20	12/5/2024	17:21	0	Cleared Main Line; Cleaned and Disinfected
61132	WQ0010495002	1902 ISABELLA ST	Storm Sewer (not contained)	Yes	121	City Cleanout	Grease Blockage	12/6/2024	10:39	12/6/2024	12:40	1	Cleared City Clean Out; Cleaned and Disinfected
61133	WQ0010495090	212 LENOX ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/6/2024	10:45	12/6/2024	10:46	0	Cleaned and Disinfected; Cleared City Clean Out
61136	WQ0010495037	8007 ASHLEY CIRCLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Roots	12/6/2024	12:42	12/6/2024	12:43	0	Cleaned and Disinfected; Cleared Service Lateral
61142	WQ0010495002	6410 MARTIN LUTHER KING BLVD	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	12/7/2024	9:07	12/7/2024	9:08	0	Cleared Main Line; Cleaned and Disinfected
61143	WQ0010495090	2011 MCKINNEY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/7/2024	11:15	12/7/2024	11:16	0	Cleaned and Disinfected
61144	WQ0010495002	4509 DEWBERRY ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/7/2024	12:42	12/7/2024	12:43	0	Cleared Service Lateral
61145	WQ0010495016	9001 TALTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/7/2024	12:07	12/7/2024	12:08	0	Cleaned and Disinfected; Cleared Service Lateral
61150	WQ0010495030	6505 WESTHEIMER RD	Storm Sewer (not contained)	Yes	126	Manhole	Rags/Wipes	12/8/2024	7:45	12/8/2024	9:51	1	Cleared Main Line; Cleaned and Disinfected
61162	WQ0010495002	5213 JEFFERSON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/9/2024	10:28	12/9/2024	10:29	0	Cleared City Clean Out; Cleaned and Disinfected
61164	WQ0010495003	12610 SKYVIEW CREEK CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/9/2024	9:40	12/9/2024	9:41	0	Cleared Main Line; Cleaned and Disinfected
61165	WQ0010495090	3209 FIRNAT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/9/2024	10:41	12/9/2024	10:42	0	Cleared Service Lateral; Cleaned and Disinfected
61168	WQ0010495037	6834 HAZEN ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Grease Blockage	12/9/2024	10:55	12/9/2024	10:56	0	Cleared Main Line; Cleaned and Disinfected
61169	WQ0010495030	6425 WESTHEIMER RD	Storm Sewer (not contained)	Yes	2665	Manhole	Grease Blockage	12/9/2024	17:30	12/10/2024	11:16	2	Cleared Main Line; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61170	WQ0010495003	3514 SHEPHERD DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1555	City Cleanout	Collection system structural failure	12/9/2024	14:05	12/11/2024	16:30	1	Set Bypass Pump; Cleaned and Disinfected
61172	WQ0010495090	7815 WILEYVALE RD	Storm Sewer (not contained)	Yes	0	City Cleanout	Grease Blockage	12/9/2024	15:00	12/9/2024	15:01	0	Cleaned and Disinfected; Cleared City Clean Out
61174	WQ0010495076	1921 WAVELL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	12/9/2024	17:00	12/9/2024	17:01	0	Cleaned and Disinfected
61175	WQ0010495090	8802 MANUS ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Collection system structural blockage	12/10/2024	8:41	12/10/2024	8:42	0	Cleaned and Disinfected
61177	WQ0010495002	4709 EMANCIPATION AVE	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/10/2024	9:08	12/10/2024	9:09	0	Cleared Main Line; Cleaned and Disinfected
61181	WQ0010495002	9350 POINT DR	Storm Sewer (not contained)	Yes	12915	Manhole	Grease Blockage	12/10/2024	10:30	12/13/2024	10:15	3	Set Bypass Pump; Cleaned and Disinfected
61186	WQ0010495002	3715 ST CHARLES ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Rags/Wipes	12/10/2024	11:52	12/10/2024	11:53	0	Cleared City Clean Out; Cleaned and Disinfected
61192	WQ0010495002	3403 BEULAH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/10/2024	12:25	12/10/2024	12:26	0	Cleaned and Disinfected
61196	WQ0010495126	12922 ROSE LANDING DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/10/2024	13:43	12/10/2024	13:44	0	Cleaned and Disinfected
61198	WQ0010495090	335 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/10/2024	13:58	12/10/2024	13:59	0	Cleaned and Disinfected; Set Bypass Pump
61201	WQ0010495010	421 DE HAVEN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Grease Blockage	12/10/2024	14:50	12/10/2024	14:51	0	Cleared Main Line; Cleaned and Disinfected
61203	WQ0010495090	1211 FARWOOD ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Gravity Main	Collection system structural failure	12/10/2024	15:00	12/10/2024	15:01	0	Set Bypass Pump; Cleaned and Disinfected
61204	WQ0010495002	2900 HOLMAN ST	Storm Sewer (not contained)	Yes	0	City Cleanout	Rags/Wipes	12/10/2024	16:41	12/10/2024	16:42	0	Cleared City Clean Out; Cleaned and Disinfected
61205	WQ0010495037	5243 CAVERSHAM DR	Storm Sewer (not contained)	Yes	39	Manhole	Grease Blockage	12/10/2024	16:12	12/11/2024	12:07	0	Cleared Main Line; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61206	WQ0010495090	6701 BLEKER ST	Bayou/surface water/drainage ditch	Yes	0	Manhole	Grease Blockage	12/10/2024	17:03	12/10/2024	17:04	0	Cleaned and Disinfected; Cleared Main Line
61207	WQ0010495090	7815 BETTY JANE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/11/2024	9:16	12/11/2024	9:17	0	Cleared City Clean Out; Cleaned and Disinfected
61208	WQ0010495077	1626 FEDERAL RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	12/11/2024	8:54	12/11/2024	8:55	0	Cleaned and Disinfected
61210	WQ0010495090	910 FAIR OAKS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/11/2024	10:06	12/11/2024	10:07	0	Cleared Main Line; Cleaned and Disinfected
61212	WQ0010495075	10702 SAGEDOWNE LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/11/2024	10:55	12/11/2024	10:56	0	Cleaned and Disinfected; Cleared City Clean Out
61213	WQ0010495090	8514 COWART ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/11/2024	10:57	12/11/2024	10:58	0	Cleared Main Line; Cleaned and Disinfected
61215	WQ0010495090	323 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/11/2024	12:30	12/11/2024	12:31	0	Cleaned and Disinfected; Set Bypass Pump
61218	WQ0010495003	1605 MONTROSE BLVD	Storm Sewer (not contained)	Yes	262	Manhole	Grease Blockage	12/11/2024	13:53	12/11/2024	18:15	1	Cleaned and Disinfected; Cleared Main Line
61235	WQ0010495003	1701 COMMONWEALTH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	596	City Cleanout	Rags/Wipes	12/12/2024	11:01	12/12/2024	20:57	1	Cleared Service Lateral; Cleaned and Disinfected
61239	WQ0010495076	5026 ANTOINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/12/2024	11:21	12/12/2024	11:22	0	Cleared Main Line; Cleaned and Disinfected
61241	WQ0010495010	9739 CARGILL ST	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Collection system structural failure	12/12/2024	4:20	12/12/2024	4:21	0	Cleaned and Disinfected; Cleared Service Lateral
61247	WQ0010495077	13367 EMPORIA ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/13/2024	8:27	12/13/2024	8:28	0	Cleared Main Line; Cleaned and Disinfected
61249	WQ0010495016	7339 GLEN MANOR DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/13/2024	9:54	12/13/2024	9:55	0	Cleaned and Disinfected
61251	WQ0010495002	6835 LOOP FWY	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/13/2024	10:14	12/13/2024	10:15	0	Cleared Main Line; Cleaned and Disinfected
61253	WQ0010495037	3033 FOUNTAIN VIEW DR	Storm Sewer (not contained)	Yes	348	Manhole	Rags/Wipes	12/13/2024	13:33	12/13/2024	16:27	2	Cleaned and Disinfected; Cleared Main Line
61255	WQ0010495090	6702 IRVINGTON BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/14/2024	12:37	12/14/2024	12:38	0	Cleaned and Disinfected; Cleared Service Lateral; Cleared Main Line
61256	WQ0010495090	519 TURNER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/14/2024	13:06	12/14/2024	13:07	0	Cleaned and Disinfected; Cleared City Clean Out
61258	WQ0010495002	927 OGILVIE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	99	Manhole	Grease Blockage	12/15/2024	9:57	12/15/2024	11:36	1	Cleared Main Line; Cleaned and Disinfected
61260	WQ0010495090	2345 MARGARET ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/15/2024	13:27	12/15/2024	13:28	0	Cleared City Clean Out; Cleaned and Disinfected
61262	WQ0010495002	5010 RAPIDO RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/16/2024	8:03	12/16/2024	8:04	0	Cleared Main Line; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61265	WQ0010495023	5426 TOMMYE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/16/2024	11:00	12/16/2024	11:01	0	Cleaned and Disinfected; Set Bypass Pump
61271	WQ0010495010	9525 CLINTON DR	Bayou/surface water/drainage ditch	Yes	0	Gravity Main	Collection system structural blockage	12/16/2024	14:09	12/16/2024	14:10	0	Cleared Service Lateral; Cleaned and Disinfected
61274	WQ0010495010	8806 MISSISSIPPI ST	Bayou/surface water/drainage ditch	Yes	4412	Manhole	Collection system structural blockage	12/16/2024	15:53	12/19/2024	17:25	1	Set Bypass Pump; Cleared Main Line; Cleaned and Disinfected
61283	WQ0010495037	3006 VALLEY PEAK DR	Storm Sewer (not contained)	Yes	1242	City Cleanout	Rags/Wipes	12/17/2024	11:04	12/17/2024	16:17	4	Cleaned and Disinfected; Cleared City Clean Out
61284	WQ0010495016	8804 SURRY ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	12/17/2024	11:52	12/17/2024	11:53	0	Cleared City Clean Out; Cleaned and Disinfected
61287	WQ0010495090	6601 ROYALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/17/2024	12:47	12/17/2024	12:47	0	Cleared Main Line; Cleaned and Disinfected
61288	WQ0010495090	6705 BLEKER ST	Bayou/surface water/drainage ditch	Yes	0	Private Cleanout	Rags/Wipes	12/17/2024	11:35	12/17/2024	11:36	0	Cleaned and Disinfected; Cleared Main Line
61298	WQ0010495111	12133 BEECHNUT ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/18/2024	10:00	12/18/2024	10:01	0	Cleared Main Line; Cleaned and Disinfected
61302	WQ0010495090	2327 COMMERCE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/18/2024	10:14	12/18/2024	10:15	0	Cleaned and Disinfected; Cleared Service Lateral
61303	WQ0010495077	13125 INDIANAPOLIS ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	12/18/2024	10:30	12/18/2024	10:31	0	Cleaned and Disinfected
61305	WQ0010495146	4023 APPALACHIAN TRL	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Roots	12/18/2024	14:29	12/18/2024	14:30	0	Cleaned and Disinfected; Cleared Service Lateral
61307	WQ0010495090	1011 10TH ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	322	Manhole	Grease Blockage	12/19/2024	8:30	12/19/2024	11:11	2	Cleared Main Line; Cleaned and Disinfected
61309	WQ0010495037	5909 FONDREN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/19/2024	9:42	12/19/2024	9:43	0	Cleared Main Line; Cleaned and Disinfected
61310	WQ0010495090	1107 PASCHALL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/19/2024	10:03	12/19/2024	10:04	0	Cleaned and Disinfected; Cleared Service Lateral
61312	WQ0010495090	8513 HIGHCREST DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/19/2024	12:21	12/19/2024	12:22	0	Cleared Service Lateral; Cleaned and Disinfected
61313	WQ0010495119	12302 SHADOWPOINT DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/19/2024	14:07	12/19/2024	14:08	0	Cleared Service Lateral; Cleaned and Disinfected
61314	WQ0010495076	3006 AREBA ST	Storm Sewer (not contained)	Yes	0	Service Lateral	Collection system structural failure	12/19/2024	15:16	12/19/2024	15:17	0	Cleaned and Disinfected
61315	WQ0010495037	8400 WESTGLEN DR	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	12/19/2024	15:50	12/19/2024	15:51	0	Cleared Main Line; Cleaned and Disinfected
61317	WQ0010495037	3610 GLEN HAVEN BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/20/2024	8:42	12/20/2024	8:43	0	Cleared Service Lateral; Cleaned and Disinfected
61338	WQ0010495090	5512 BUNTE ST	Bayou/surface water/drainage ditch	Yes	0	City Cleanout	Grease Blockage	12/20/2024	11:23	12/20/2024	11:24	0	Cleaned and Disinfected; Cleared City Clean Out
61339	WQ0010495110	15827 BAYBRIAR DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/20/2024	10:26	12/20/2024	10:27	0	Cleaned and Disinfected
61341	WQ0010495090	2424 SAKOWITZ ST	Bayou/surface water/drainage ditch	Yes	1378	Manhole	Rags/Wipes	12/20/2024	12:19	12/20/2024	15:30	7	Cleaned and Disinfected; Cleared Main Line



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61344	WQ0010495090	2933 KIRK ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/20/2024	14:30	12/20/2024	14:31	0	Cleaned and Disinfected; Cleared Service Lateral
61346	WQ0010495119	7615 SKYLINE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/21/2024	8:10	12/21/2024	8:11	0	Cleaned and Disinfected; Cleared Service Lateral
61347	WQ0010495010	9830 RACINE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/21/2024	10:12	12/21/2024	10:13	0	Cleared City Clean Out; Cleaned and Disinfected
61350	WQ0010495016	8902 SPAULDING ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/21/2024	14:24	12/21/2024	14:25	0	Cleared Main Line; Cleaned and Disinfected
61361	WQ0010495002	3832 MAINER ST	Within 5 ft. of Bayou/Surface Water/Drainage Ditch	Yes	0	City Cleanout	Grease Blockage	12/23/2024	8:22	12/23/2024	8:23	0	Cleared Service Lateral; Cleaned and Disinfected
61363	WQ0010495116	3143 MEADWAY DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/23/2024	11:56	12/23/2024	11:57	0	Cleared Service Lateral; Cleaned and Disinfected
61373	WQ0010495030	2727 ELMSIDE DR	Storm Sewer (not contained)	Yes	2522	Manhole	Grease Blockage	12/23/2024	13:53	12/24/2024	10:56	2	Cleared Service Lateral; Cleaned and Disinfected
61375	WQ0010495009	4829 WILMINGTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/23/2024	14:20	12/23/2024	14:21	0	Cleared Service Lateral; Cleaned and Disinfected
61381	WQ0010495037	4125 WOODFOX ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/23/2024	15:51	12/23/2024	15:52	0	Cleared Service Lateral; Cleaned and Disinfected
61382	WQ0010495050	11719 ALMEDA GENOA RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/23/2024	15:46	12/23/2024	15:47	0	Cleared Main Line; Cleaned and Disinfected
61383	WQ0010495149	1444 KINGWOOD DR	Storm Sewer (not contained)	Yes	0	Manhole	Grease Blockage	12/23/2024	15:58	12/23/2024	15:59	0	Cleared Main Line; Cleaned and Disinfected
61384	WQ0010495111	6338 CORPORATE DR	Storm Sewer (not contained)	Yes	506	Manhole	Grease Blockage	12/23/2024	15:33	12/23/2024	19:45	2	Cleared Main Line; Cleaned and Disinfected
61386	WQ0010495119	10607 ZIRCON CT	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/23/2024	17:53	12/23/2024	17:54	0	Cleaned and Disinfected; Cleared Main Line
61390	WQ0010495016	9402 BALSAM LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	169	Private Cleanout	Grease Blockage	12/24/2024	8:39	12/24/2024	11:28	1	Cleared Main Line; Cleaned and Disinfected
61395	WQ0010495116	3214 ASHLOCK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/24/2024	10:30	12/24/2024	10:31	0	Cleaned and Disinfected; Cleared Service Lateral
61396	WQ0010495119	8818 BELLE GLEN DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	19	Manhole	Grease Blockage	12/24/2024	11:30	12/25/2024	10:37	0	Cleared Main Line; Cleaned and Disinfected
61398	WQ0010495119	10101 SAM HOUSTON PKWY	Storm Sewer (not contained)	Yes	3462	Manhole	Rags/Wipes	12/24/2024	14:55	12/25/2024	10:09	3	Cleaned and Disinfected; Cleared Main Line
61404	WQ0010495109	757 ELDRIDGE PKWY	Storm Sewer (not contained)	Yes	3400	Manhole	Pump/Lift station instrumentation failure	12/25/2024	14:19	12/25/2024	17:09	20	Set Bypass Pump
61406	WQ0010495030	10500 OLD KATY RD	Storm Sewer (not contained)	Yes	0	Private Cleanout	Grease Blockage	12/25/2024	15:15	12/25/2024	15:16	0	Cleaned and Disinfected; Cleared Main Line
61412	WQ0010495002	2520 WENTWORTH ST	Storm Sewer (not contained)	Yes	202	Manhole	Grease Blockage	12/26/2024	8:11	12/26/2024	11:33	1	Cleared Main Line; Cleaned and Disinfected
61413	WQ0010495090	2411 FULTON ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural blockage	12/26/2024	8:50	12/26/2024	8:51	0	Cleaned and Disinfected
61415	WQ0010495002	5922 HONEYSUCKLE DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/26/2024	9:35	12/26/2024	9:36	0	Cleared City Clean Out; Cleaned and Disinfected



City of Houston - Houston Public Works
Monthly SSO Report
December 2024


SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61419	WQ0010495077	12929 SAMUEL LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/26/2024	12:58	12/26/2024	12:59	0	Cleared Main Line; Cleaned and Disinfected
61420	WQ0010495139	10259 COTTAGE FIELD RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1248	City Cleanout	Rags/Wipes	12/26/2024	13:42	12/27/2024	10:30	1	Cleared Private Line; Cleaned and Disinfected
61421	WQ0010495002	3520 OLD SPANISH TRL	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/26/2024	14:20	12/26/2024	14:21	0	Cleaned and Disinfected; Set Bypass Pump
61430	WQ0010495002	3314 PECAN ST	Storm Sewer (not contained)	Yes	597	Manhole	Grease Blockage	12/27/2024	10:16	12/27/2024	13:35	3	Cleared Main Line; Cleaned and Disinfected
61431	WQ0010495002	8462 WIER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/27/2024	10:40	12/27/2024	10:41	0	Cleaned and Disinfected; Cleared Main Line
61433	WQ0010495002	8128 PARK TERRACE BLVD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/27/2024	11:40	12/27/2024	11:41	0	Cleared City Clean Out; Cleaned and Disinfected
61435	WQ0010495090	1413 COPELAND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/27/2024	11:32	12/27/2024	11:33	0	Cleaned and Disinfected; Cleared Main Line
61436	WQ0010495090	1706 HAFNER DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	1219	Manhole	Grease Blockage	12/27/2024	12:57	12/28/2024	9:16	1	Cleared Main Line; Cleaned and Disinfected
61437	WQ0010495002	4901 MALMEDY RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Grease Blockage	12/27/2024	14:06	12/27/2024	14:07	0	Cleaned and Disinfected; Cleared Main Line
61439	WQ0010495090	202 LITTLE YORK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Grease Blockage	12/27/2024	14:24	12/27/2024	14:25	0	Cleaned and Disinfected; Cleared City Clean Out
61440	WQ0010495119	7893 BISSONNET ST	Storm Sewer (not contained)	Yes	4174	Manhole	Grease Blockage	12/27/2024	14:50	12/28/2024	15:25	3	Cleaned and Disinfected; Cleared Main Line
61441	WQ0010495002	6167 BELDART ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/27/2024	15:12	12/27/2024	15:13	0	Cleaned and Disinfected
61445	WQ0010495119	8002 GESSNER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	339	City Cleanout	Rags/Wipes	12/27/2024	15:47	12/28/2024	14:22	0	Cleared City Clean Out; Cleaned and Disinfected
61446	WQ0010495090	7802 PEACHTREE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/27/2024	15:36	12/27/2024	15:37	0	Cleared City Clean Out; Cleaned and Disinfected
61450	WQ0010495119	11110 RADFORD LN	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/28/2024	8:33	12/28/2024	8:34	0	Cleaned and Disinfected; Set Bypass Pump
61454	WQ0010495090	4102 MANGUM RD	Storm Sewer (not contained)	Yes	1275	City Cleanout	Grease Blockage	12/28/2024	11:47	12/29/2024	9:02	1	Cleared Main Line; Cleaned and Disinfected
61455	WQ0010495003	5334 RIPPLEBROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Rags/Wipes	12/28/2024	12:21	12/28/2024	12:22	0	Cleared Main Line; Cleaned and Disinfected
61462	WQ0010495016	7256 PARKER RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Service Lateral	Collection system structural failure	12/29/2024	11:20	12/29/2024	11:21	0	Cleaned and Disinfected
61465	WQ0010495037	3441 UNITY DR	Storm Sewer (not contained)	Yes	8484	Service Lateral	Collection system structural failure	12/29/2024	14:03	1/1/2025	12:45	2	Cleaned and Disinfected; Set Bypass Pump
61466	WQ0010495003	14614 POST OAK RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/29/2024	14:43	12/29/2024	14:44	0	Cleaned and Disinfected; Set Bypass Pump



City of Houston - Houston Public Works
Monthly SSO Report
December 2024

SSO ID	TPDES #	Address	Flow Location	Reached Waters of the US	Est. Volume (Gallons)	Structure Type	Excursion Cause	Start Date	Start Time	End Date	End Time	Average Flow (GPM)	Corrective Action
61471	WQ0010495002	4950 BURMA RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/30/2024	8:08	12/30/2024	8:09	0	Cleaned and Disinfected; Cleared Private Line
61472	WQ0010495119	9001 IMOGENE ST	Storm Sewer (not contained)	Yes	2072	Manhole	Grease Blockage	12/30/2024	8:51	12/31/2024	19:23	1	Cleared Main Line; Cleaned and Disinfected
61476	WQ0010495090	327 72ND ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/30/2024	10:24	12/30/2024	10:25	0	Cleaned and Disinfected
61477	WQ0010495037	6718 DE MOSS DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	90	Manhole	Grease Blockage	12/30/2024	12:40	12/30/2024	13:25	2	Cleared Main Line; Cleaned and Disinfected
61481	WQ0010495002	3626 IDAHO ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural failure	12/30/2024	12:08	12/30/2024	12:09	0	Cleaned and Disinfected
61483	WQ0010495090	817 MILWAUKEE ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Collection system structural blockage	12/30/2024	14:21	12/30/2024	14:22	0	Cleaned and Disinfected
61486	WQ0010495003	1103 GRAY ST	Storm Sewer (not contained)	Yes	584	Manhole	Grease Blockage	12/30/2024	15:56	12/30/2024	20:48	2	Cleared Main Line; Cleaned and Disinfected
61495	WQ0010495037	5909 FONDREN RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/30/2024	16:42	12/30/2024	16:43	0	Cleared Main Line; Cleaned and Disinfected
61502	WQ0010495090	6007 NORDLING RD	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/31/2024	9:11	12/31/2024	9:12	0	Cleaned and Disinfected; Cleared Service Lateral
61503	WQ0010495002	1405 COLLIER ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Collection system structural failure	12/31/2024	9:58	12/31/2024	9:59	0	Cleared City Clean Out; Cleaned and Disinfected
61508	WQ0010495003	11119 RUBIN ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Private Cleanout	Rags/Wipes	12/31/2024	10:19	12/31/2024	10:20	0	Cleared Service Lateral; Cleaned and Disinfected
61509	WQ0010495090	926 WESTHEIMER RD	Storm Sewer (not contained)	Yes	0	Private Sample Well	Collection system structural failure	12/31/2024	9:52	12/31/2024	9:53	0	Cleaned and Disinfected; Cleared Service Lateral
61510	WQ0010495090	5407 CAPITOL ST	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	City Cleanout	Rags/Wipes	12/31/2024	10:29	12/31/2024	10:30	0	Cleared City Clean Out; Cleaned and Disinfected
61514	WQ0010495146	5922 ROCKY BROOK DR	Contained On Site, not within 5 ft. of Bayou/Surface Water/Drainage Ditch	No	0	Manhole	Grease Blockage	12/31/2024	14:50	12/31/2024	14:51	0	Cleared Main Line; Cleaned and Disinfected
61516	WQ0010495003	3718 RIPPLEBROOK DR	Storm Sewer (not contained)	Yes	5040	Private Cleanout	Grease Blockage	12/31/2024	16:39	1/2/2025	10:39	2	Cleaned and Disinfected; Cleared Main Line

Total Number of SSOs:	158
Number of Fish Kills Caused by SSOs:	0
Number of Notifications to the Public:	0
TWC § 7.251 Report Attached:	No

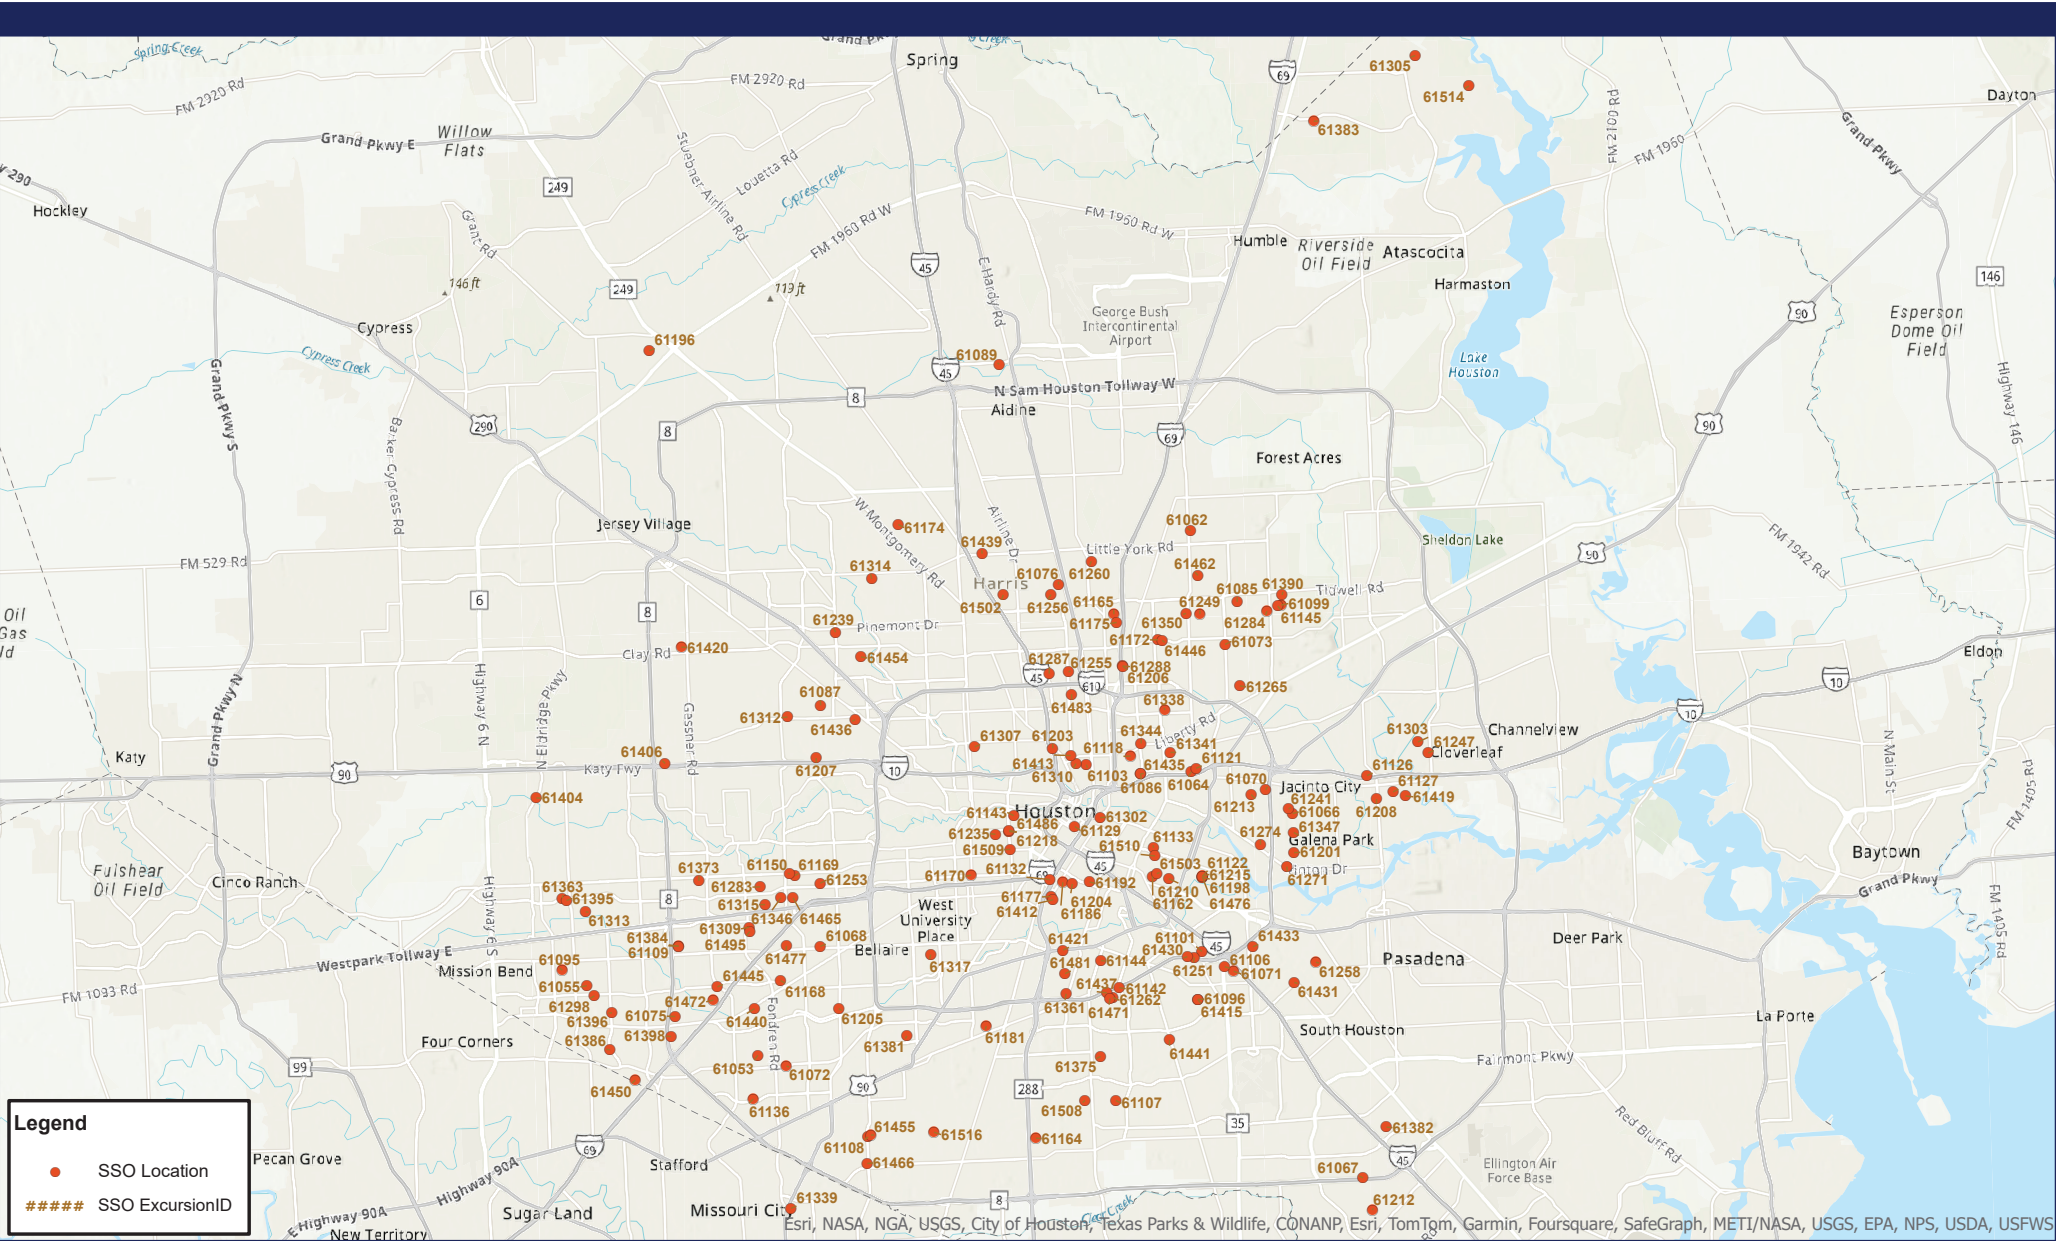

Public SSO Map - December 2024

0 2.5 5 Miles

